

AMERICAN FLOW CONTROL®

IP-71 (UNDERGROUND) INDICATOR POST

SUBMITTAL SHEET



IP-71 SUBMITTAL SHEET

Quantity: _____

Direction to Open: ☐ Left (C.C.W.) ☐ Right (C.W.)

Valve Size Post Used On: ☐ 4" ☐ 6" ☐ 8" ☐ 10" ☐ 12" ☐ 14" ☐ 16"



Model Number: _____

Other Requirements (List): _____

American Flow Control®

American-Darling Valve and Waterous

A Division of American Cast Iron Pipe Company

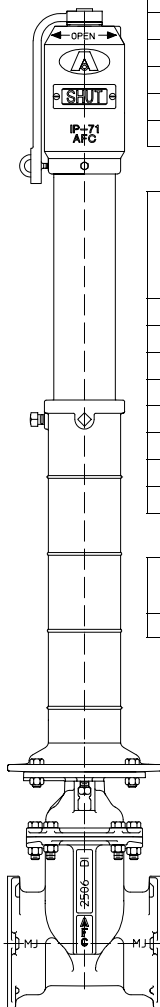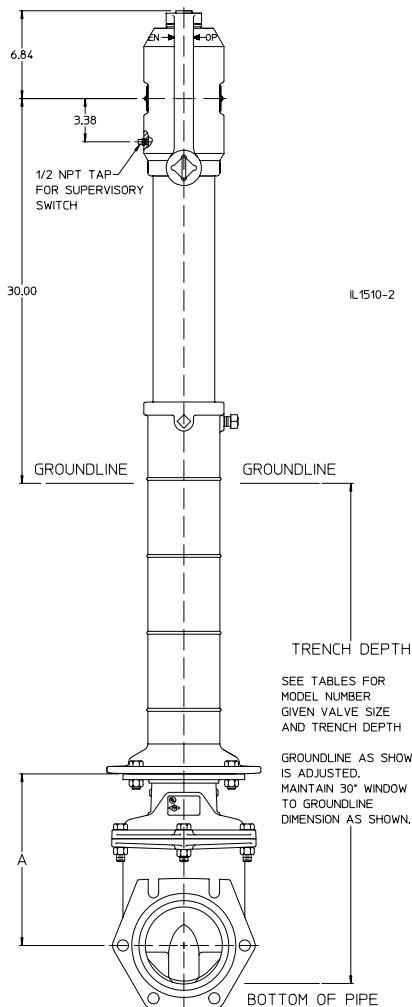

Model Number	Valve Size		
	4"	6"	8"
	Trench Depth	Trench Depth	Trench Depth
1A	2'0" – 3'0"	2'0" – 3'6"	2'6" – 4'0"
2A	3'6" – 5'0"	4'0" – 5'6"	4'6" – 6'0"
3A	5'6" – 7'0"	6'0" – 7'6"	6'6" – 8'0"
4A	7'6" – 9'0"	8'0" – 9'6"	8'6" – 10'0"
5A	9'6" – 11'0"	10'0" – 11'6"	10'6" – 12'0"
6A	11'6" – 13'0"	12'0" – 13'6"	12'6" – 14'0"
7A	13'6" – 15'0"	14'0" – 15'6"	14'6" – 16'0"
8A	15'6" – 17'0"	16'0" – 17'6"	16'6" – 18'0"

Model Number	Valve Size			
	10"	12"	14"	16"
	Trench Depth	Trench Depth	Trench Depth	Trench Depth
1B	3'0" – 4'6"	3'6" – 4'6"	4'0" – 5'0"	4'6" – 5'6"
2B	5'0" – 6'6"	5'0" – 6'6"	5'6" – 7'0"	6'0" – 7'6"
3B	7'0" – 8'6"	7'0" – 8'6"	7'6" – 9'0"	8'0" – 9'6"
4B	9'0" – 10'6"	9'0" – 10'6"	9'6" – 11'0"	10'0" – 11'6"
5B	11'0" – 12'6"	11'0" – 12'6"	11'6" – 13'0"	12'0" – 13'6"
6B	13'0" – 14'6"	13'0" – 14'6"	13'6" – 15'0"	14'0" – 15'6"
7B	15'0" – 16'6"	15'0" – 16'6"	15'6" – 17'0"	16'0" – 17'6"
8B	17'0" – 18'6"	17'0" – 18'6"	17'6" – 19'0"	18'0" – 19'6"

Dimension	Valve Size						
	4"	6"	8"	10"	12"	14"	16"
A	10.19	13.25	16.69	20.50	23.88	29.25	32.75

Visit our web site at <http://www.acipco.com/afc>

NOTE:

1. UL Listed and FM Approved.