

**38HDR  
Performance™ Series Air Conditioner  
with Puron® Refrigerant  
1 – 1/2 to 5 Nominal Tons**



## Product Data



Performance  
SERIES

Carrier's Air Conditioners with Puron® refrigerant provide a collection of features unmatched by any other family of equipment. The 38HDR has been designed utilizing Carrier's Puron refrigerant. The environmentally sound refrigerant allows you to make a responsible decision in the protection of the earth's ozone layer.

This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. Refer to the combination ratings in the Product Data for system combinations that meet Energy Star® guidelines.

**NOTE: Ratings contained in this document are subject to change at any time. Always refer to the AHRI directory ([www.ahridirectory.org](http://www.ahridirectory.org)) for the most up-to-date ratings information.**

### INDUSTRY LEADING FEATURES / BENEFITS

#### Energy Efficiency

- 13 - 15 SEER/10.9 - 12.5 EER

#### Sound

- Levels as low as 68 dBA

#### Design Features

- New aesthetics
- Small footprint, same as old model and "stackable"
- WeatherArmor™ cabinet
  - All steel cabinet construction
  - Baked on powder paint
  - Mesh coil guard

#### Reliability, Quality and Toughness

- Scroll compressor
- Crankcase Heater standard on sizes 030-060
- Factory-supplied filter drier
- High pressure switch
- Low pressure switch
- Line lengths up to 250' (76.2 m)
- Low ambient operation (down to -20°F/-28.9°C) with low ambient accessories.

# MODEL NUMBER NOMENCLATURE

1	2	3	4	5	6	7	8	9	10	11	12	13
N	N	A	A	A/N	N	N	N	A/N	A/N	A/N	N	N
3	8	H	D	R	0	1	8	A	0	0	3	0

Product Series	HDR = Horizontal Discharge Condensing Unit	Cooling Capacity	Variations	Open	Open	Voltage	Minor Series
38=AC/HP	Major Model	1,000 Btuh Nominal	A=Standard	0=Not Defined	0=Not Defined	3=208/230-1 5=208/230-3 6=460/3	0, 1, 2...

38HDR



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to [www.ahridirectory.org](http://www.ahridirectory.org).



ISO 9001  
QMI-SAI Global



This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. However, proper refrigerant charge and proper air flow are critical to achieve rated capacity and efficiency. Installation of this product should follow all manufacturing refrigerant charging and air flow instructions. **Failure to confirm proper charge and air flow may reduce energy efficiency and shorten equipment life.**

## PHYSICAL DATA

UNIT 38HDR	018	024	030	036	048	060
<b>NOMINAL CAPACITY (Tons)</b>	1.5	2.0	2.50	3.0	4.0	5.0
<b>OPERATING WEIGHT lb (kg)</b>	155 (70.3)	180 (81.6)	200 (90.7)	218 (98.9)	284 (128.8)	294 (133.4)
<b>REFRIGERANT TYPE</b>	R-410A					
<b>METERING DEVICE</b>	TXV					
<b>CHARGE lb (kg)</b>	6.3 (2.86)	6.0 (2.73)	8.7 (3.95)	8.7 (3.95)	11.5 (5.23)	12.0 (5.45)
<b>COMPRESSOR</b>	Scroll					
Type	Scroll					
Oil Charge (POE – oz)	25.0	25.0	25.0	25.0	42.0	42.0
Crankcase Heater (watts)	—	—	40	40	40	40
<b>OUTDOOR FAN</b>	Rpm/Cfm					
	840/1720	840/1720	850/3900	850/3900	850/3900	850/3900
Diameter in. (mm)	18 (457)	18 (457)	24 (610)	24 (610)	24 (610)	24 (610)
No. Blades	3	3	3	3	3	3
Motor hp (w)	1/8 (93)	1/8 (93)	1/4 (187)	1/4 (187)	1/4 (187)	1/4 (187)
<b>OUTDOOR COIL</b>	Face Area (sq ft)					
	5.8	7.3	12.1	12.1	14.1	14.1
No. Rows	2	2	2	2	2	2
FPI	20	20	20	20	20	20
<b>HIGH PRESSURE SWITCH</b>	Cut-In (psig) Cutout (psig)					
	420 ± 25 650 ± 10	420 ± 25 650 ± 10	420 ± 25 650 ± 10	420 ± 25 650 ± 10	420 ± 25 650 ± 10	420 ± 25 650 ± 10
<b>LOW PRESSURE SWITCH</b>	Cut-In (psig) Cutout (psig)					
	45 ± 25 20 ± 5	45 ± 25 20 ± 5	45 ± 25 20 ± 5	45 ± 25 20 ± 5	45 ± 25 20 ± 5	45 ± 25 20 ± 5
<b>REFRIGERANT LINES</b>	Connection Type					
	Sweat					
Max. Liquid Line* (in.) OD	3/8	3/8	3/8	3/8	3/8	3/8
Rated Vapor Line† (in.) OD	5/8	5/8	3/4	3/4	7/8	1-1/8**
<b>CONTROLS</b>	Control Voltage‡					
	24 vac					
System Voltage	208/230 v	208/230 v	208/230 v	208/230 v, Single and 3 Phase, 460 v, 3 Phase		
<b>FINISH</b>	Gray					

\* See Liquid Line Sizing For Cooling Only Systems with Puron Refrigerant tables.

† Units are rated with 25 ft (7.6 m) of lineset length. See Vapor Line Sizing and Cooling Capacity Loss table when using other sizes and lengths of lineset.

‡ 24 v and a minimum of 40 va is provided in the fan coil unit.

\*\* Vapor connection size is 7/8 inch.

FPI – Fins Per Inch

POE – Polyol Ester

# REFRIGERANT PIPING LENGTH LIMITATIONS

## Liquid Line Sizing and Maximum Total Equivalent Lengths† for Cooling Only Systems with Puron® Refrigerant:

The maximum allowable length of a residential split system depends on the liquid line diameter and vertical separation between indoor and outdoor units.

See Table below for liquid line sizing and maximum lengths :

### Maximum Total Equivalent Length Outdoor Unit BELOW Indoor Unit

Size	Liquid Line Connection	Liquid Line Diam. w/ TXV	AC with Puron Refrigerant Maximum Total Equivalent Length†: Outdoor unit BELOW Indoor Vertical Separation ft (m)								
			0-5 (0-1.5)	6-10 (1.8-3.0)	11-20 (3.4-6.1)	21-30 (6.4-9.1)	31-40 (9.4-12.2)	41-50 (12.5-15.2)	51-60 (15.5-18.3)	61-70 (18.6-21.3)	71-80 (21.6-24.4)
018 AC with Puron	3/8	1/4	150	150	125	100	100	75	--	--	--
		5/16	250*	250*	250*	250*	250*	250*	250*	225*	150
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
024 AC with Puron	3/8	1/4	75	75	75	50	50	--	--	--	--
		5/16	250*	250*	250*	250*	250*	225*	175	125	100
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
030 AC with Puron	3/8	1/4	30	--	--	--	--	--	--	--	--
		5/16	175	225*	200	175	125	100	75	--	--
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
036 AC with Puron	3/8	5/16	175	150	150	100	100	100	75	--	--
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
048 AC with Puron	3/8	3/8	250*	250*	250*	250*	250*	250*	230	160	--
060 AC with Puron	3/8	3/8	250*	250*	250*	225*	190	150	110	--	--

\* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

-- = outside acceptable range

38HDR

### Maximum Total Equivalent Length Outdoor Unit ABOVE Indoor Unit

Size	Liquid Line Connection	Liquid Line Diam. w/ TXV	AC with Puron Refrigerant Maximum Total Equivalent Length†: Outdoor unit ABOVE Indoor Vertical Separation ft (m)								
			25 (7.6)	26-50 (7.9-15.2)	51-75 (15.5-22.9)	76-100 (23.2-30.5)	101-125 (30.8-38.1)	126-150 (38.4-45.7)	151-175 (46.0-53.3)	176-200 (53.6-61.0)	
018 AC with Puron	3/8	1/4	175	250*	250*	250*	250*	250*	250*	250*	250*
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
024 AC with Puron	3/8	1/4	100	125	175	200	225*	250*	250*	250*	250*
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
030 AC with Puron	3/8	1/4	30	--	--	--	--	--	--	--	--
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
036 AC with Puron	3/8	5/16	225*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
048 AC with Puron	3/8	3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
060 AC with Puron	3/8	3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*

\* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

-- = outside acceptable range

## REFRIGERANT CHARGE ADJUSTMENTS

Liquid Line Size	Puron Charge oz/ft (g/m)
3/8	0.60 (17.74) (Factory charge for lineset = 9 oz / 266.16 g)
5/16	0.40 (11.83)
1/4	0.27 (7.98)

Units are factory charged for 15 ft (4.6 m) of 3/8" liquid line. The factory charge for 3/8" lineset 9 oz (266.16 g). When using other length or diameter liquid lines, charge adjustments are required per the chart above.

### Charging Formula:

$[(\text{Lineset oz/ft} \times \text{total length}) - (\text{factory charge for lineset})] = \text{charge adjustment}$

**Example 1:** System has 15 ft of line set using existing 1/4" liquid line. What charge adjustment is required?

Formula:  $(.27 \text{ oz/ft} \times 15\text{ft}) - (9 \text{ oz}) = (-4.95) \text{ oz.}$

Net result is to remove 4.95 oz of refrigerant from the system

**Example 2:** System has 45 ft of existing 5/16" liquid line. What is the charge adjustment?

Formula:  $(.40 \text{ oz/ft.} \times 45\text{ft}) - (9 \text{ oz.}) = 9 \text{ oz.}$

Net result is to add 9 oz of refrigerant to the system

## LONG LINE APPLICATIONS

An application is considered Long Line, when the refrigerant level in the system requires the use of accessories to maintain acceptable refrigerant management for systems reliability. See Accessory Usage Guideline table for required accessories. Defining a system as long line depends on the liquid line diameter, actual length of the tubing, and vertical separation between the indoor and outdoor units.

For Air Conditioner systems, the chart below shows when an application is considered Long Line.

### AC WITH PURON® REFRIGERANT LONG LINE DESCRIPTION ft (m)

**Beyond these lengths, long line accessories are required**

Liquid Line Size	Units On Same Level	Outdoor Below Indoor	Outdoor Above Indoor
1/4	No accessories needed within allowed lengths	No accessories needed within allowed lengths	175 (53.3)
5/16	120 (36.6)	50 (15.2) vertical or 120 (36.6) total	120 (36.6)
3/8	80 (24.4)	35 (10.7) vertical or 80 (24.4) total	80 (24.4)

**Note:** See Long Line Guideline for details

## VAPOR LINE SIZING AND COOLING CAPACITY LOSS

Acceptable vapor line diameters provide adequate oil return to the compressor while avoiding excessive capacity loss. The suction line diameters shown in the chart below are acceptable for AC systems with Puron refrigerant:

### Vapor Line Sizing and Cooling Capacity Losses — Puron® Refrigerant 1-Stage Air Conditioner Applications

Unit Nominal Size (Btuh)	Maximum Liquid Line Diameters (In. OD)	Vapor Line Diameters (In. OD)	Cooling Capacity Loss (%)									
			Total Equivalent Line Length ft. (m)									
			26-50 (7.9-15.2)	51-80 (15.5-24.4)	81-100 (24.7-30.5)	101-125 (30.8-38.1)	126-150 (38.4-45.7)	151-175 (46.0-53.3)	176-200 (53.6-61.0)	201-225 (61.3-68.6)	226-250 (68.9-76.2)	
018 1 Stage AC with Puron	3/8	1/2	1	2	3	5	6	7	8	9	11	
		5/8	0	1	1	1	2	2	2	3	3	
		3/4	0	0	0	0	1	1	1	1	1	1
024 1 Stage AC with Puron	3/8	5/8	0	1	2	2	3	3	4	5	5	
		3/4	0	0	1	1	1	1	1	2	2	
		7/8	0	0	0	0	0	1	1	1	1	1
030 1 Stage AC with Puron	3/8	5/8	1	2	3	3	4	5	6	7	8	
		3/4	0	0	1	1	1	2	2	2	3	
		7/8	0	0	0	0	1	1	1	1	1	1
036 1 Stage AC with Puron	3/8	5/8	1	2	4	5	6	8	9	10	12	
		3/4	0	1	1	2	2	3	3	4	4	
		7/8	0	0	0	1	1	1	1	2	2	
048 1 Stage AC with Puron	3/8	3/4	0	1	2	3	4	5	5	6	7	
		7/8	0	0	1	1	2	2	2	3	3	
		1 1/8	0	0	0	0	0	0	0	1	1	
060 1 Stage AC with Puron	3/8	3/4	1	2	4	5	6	7	9	10	11	
		7/8	0	1	2	2	3	4	4	5	5	
		1 1/8	0	0	0	1	1	1	1	1	1	1

Applications in this area may be long line and may have height restrictions. See the *Residential Piping and Long Line Guideline*.

## ACCESSORY THERMOSTATS

THERMOSTAT / SUBBASE PKG.	DESCRIPTION
TP-PRH01-A	Programmable Thermostat
TP-NRH01-A	Non-programmable Thermostat
TP-PAC01	Performance Series Programmable AC Stat
TP-NAC01	Performance Series Non-programmable AC Stat
TSTATCCSEN01-B	Outdoor Air Temperature Sensor
TSTATXXBBP01	Backplate for Builder's Thermostat
TSTATXXNBP01	Backplate for Non-Programmable Thermostat
TSTATXXBP01	Backplate for Programmable Thermostat
TSTATXXCNV10	Thermostat Conversion Kit (4 to 5 wires) - 10 Pack

## ACCESSORIES

KIT NUMBER	KIT NAME	018	024	030	036	048	060
KAACH1401AAA	Crankcase Heater	X	X				
Standard	Crankcase Heater			S	S	S	S
KAAPT0101AAA	Evaporator Freeze Stat	X	X	X	X	X	X
KAATD0101TDR	Time Delay Relay	X	X	X	X	X	X
KAAWS0101AAA	Winter Start Kit (for low ambient)	X	X	X	X	X	X
53DS-900---086	Low Ambient Control (Puron)	X	X	X	X	X	X
53DS-900---070	Wind Baffle	X					
53DS-900---087	Wind Baffle		X				
53DS-900---071	Wind Baffle			X	X		
53DS-900---088	Wind Baffle					X	X
53DS-900---075	Stacking Kit	X	X				
53DS-900---076	Stacking Kit			X	X	X	X
53DS-900---077	Wall Mounting Kit	X	X				
53DS-900---078	Wall Mounting Kit			X	X	X	X

X = Accessory, S = Standard

38HDR

# ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT COOLING APPLICATIONS (Below 55°F/12.8°C)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 ft. / 24.4 m)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles / 3.2 km)
Compressor Start Assist Capacitor and Relay	Yes	Yes	No
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
Hard Shutoff TXV	Yes	Yes	Yes
Liquid Line Solenoid Valve	No	See Longline Application Guideline	No
Low-ambient Control	Yes	No	No
Winter Start Control	Yes	No	No

\* For tubing line sets between 80 and 200 ft. (24.38 and 60.96 m) and/or 35 ft. (10.7 m) vertical differential, refer to Residential Piping and Longline Guideline.

## Accessory Description and Usage (Listed Alphabetically)

### 1. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage Guideline:

- Required in low ambient cooling applications.
- Required in long line applications.
- Suggested in all commercial applications.

### 2. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

- Required when low ambient kit has been added.

### 3. Low-Ambient Control

A fan-speed control device activated by a temperature sensor, designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to -20°F (-28.9°C), it maintains condensing temperature at 100°F ±10°F (37.8°C ± 5.5°C).

Usage Guideline:

- A Low Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

### 4. Outdoor Air Temperature Sensor

Designed for use with Carrier Thermostats listed in this publication. This device enables the thermostat to display the outdoor temperature. This device also

is required to enable special thermostat features such as auxiliary heat lock out.

Usage Guideline:

- Suggested for all Carrier thermostats listed in this publication.

### 5. Thermostatic Expansion Valve (TXV)

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Kit includes valve, adapter tubes, and external equalizer tube. Hard shut off types are available.

**NOTE:** When using a hard shut off TXV with single phase reciprocating compressors, a Compressor Start Assist Capacitor and Relay is required.

Usage Guideline:

- Accessory required to meet AHRI rating and system reliability, where indoor not equipped.
- Hard shut off TXV or LLS required in air conditioner long line applications.
- Required for use on all zoning systems.

### 6. Time-Delay Relay

An SPST delay relay which briefly continues operation of indoor blower motor to provide additional cooling after the compressor cycles off.

**NOTE:** Most indoor unit controls include this feature. For those that do not, use the guideline below.

Usage Guideline:

- Accessory required to meet AHRI rating, where indoor not equipped.

### 7. Winter Start Control

This control is designed to alleviate nuisance opening of the low-pressure switch by bypassing it for the first 3 minutes of operation.

# ELECTRICAL DATA

38HDR UNIT SIZE	V-PH-Hz	VOLTAGE RANGE*		COMPRESSOR		OUTDOOR FAN MOTOR			MIN CKT AMPS	FUSE/CKT BKR AMPS
		Min	Max	RLA	LRA	FLA	NEC Hp	kW Out		
018-31	208/230-1-60	187	253	9.0	48.0	0.8	0.125	0.09	12.1	20
024-32	208/230-1-60	187	253	13.5	58.3	0.8	0.125	0.09	17.7	25
030-31	208/230-1-60	187	253	14.1	73.0	1.5	0.250	0.19	19.1	30
036-31	208/230-1-60	187	253	14.1	77.0	1.5	0.250	0.19	19.1	30
	208/230-3-60	187	253	9.2	71.0	1.5	0.250	0.19	13.0	20
	460-3-60	414	506	5.6	38.0	0.8	0.250	0.19	7.9	10
048-32	208/230-1-60	187	253	19.9	109.0	1.5	0.250	0.19	26.4	40
	208/230-3-60	187	253	13.1	83.1	1.5	0.250	0.19	17.9	25
	460-3-60	414	506	6.1	41.0	0.8	0.250	0.19	8.4	15
060-32	208/230-1-60	187	253	26.4	134.0	1.5	0.250	0.19	34.5	60
	208/230-3-60	187	253	16.0	110.0	1.5	0.250	0.19	21.5	30
	460-3-60	414	506	7.8	52.0	0.8	0.250	0.19	10.6	15

\* Permissible limits of the voltage range at which the unit will operate satisfactorily

- FLA – Full Load Amps
- HACR – Heating, Air Conditioning, Refrigeration
- LRA – Locked Rotor Amps
- NEC – National Electrical Code
- RLA – Rated Load Amps (compressor)

**NOTE:** Control circuit is 24-V on all units and requires external power source. Copper wire must be used from service disconnect to unit. All motors/compressors contain internal overload protection.

Complies with 2007 requirements of ASHRAE Standards 90.1

38HDR

## A-WEIGHTED SOUND POWER (dBA)

Unit Size	Standard Rating (dBA)	Typical Octave Band Spectrum ( dBA ) (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
018-31	68	52.0	57.5	60.5	63.5	60.5	57.5	46.5
024-32	69	57.5	61.5	63.0	61.0	60.0	56.0	45.0
030-31	72	56.5	63.0	65.0	66.0	64.0	62.5	57.0
036-31	72	65.0	61.5	63.5	65.0	64.5	61.0	54.5
048-32	72	58.5	61.0	64.0	67.5	66.0	64.0	57.0
060-32	72	63.0	61.5	64.0	66.5	66.0	64.5	55.5

**NOTE:** Tested in accordance with AHRI Standard 270-08 (not listed in AHRI).

## CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)


UNIT SIZE-VOLTAGE, SERIES	REQUIRED SUBCOOLING °F (°C)
018-31	12 (6.7)
024-32	12 (6.7)
030-31	12 (6.7)
036-31	12 (6.7)
048-32	12 (6.7)
060-32	12 (6.7)

DIMENSIONS - ENGLISH

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	A	B	C	D	E	F	G	H	J	K	L	M	N	P	OPERATING WEIGHT(lbs)	SHIPPING WEIGHT(lbs)	SHIPPING DIMENSIONS (L x W x H)
38HDR018	1	X 0 0	25 1/8"	36 15/16"	14 9/16"	16"	23 7/16"	17 3/16"	17 1/8"	22"	13"	6 5/8"	11 1/4"	5/8"	2 15/16"	6"	155	171	42 9/10" X 18" X 28 1/10"
38HDR024	1,2	X 0 0	31 1/8"	36 15/16"	14 9/16"	16"	23 7/16"	17 3/16"	23 1/8"	28"	14"	6 3/4"	11 5/8"	5/8"	2 15/16"	6"	180	198	42 9/10" X 18" X 34 1/10"
38HDR030	1	X 0 0	37 3/16"	44 9/16"	17 1/16"	18 7/16"	30 1/2"	19 5/8"	29 3/16"	34 1/16"	13 11/16"	8 1/8"	15 7/8"	3/4"	3 7/16"	6 1/2"	200	223	50 1/2" X 20 1/2" X 40 2/10"
38HDR036	1	X 0 X	37 3/16"	44 9/16"	17 1/16"	18 7/16"	30 1/2"	19 5/8"	29 3/16"	34 1/16"	13 11/16"	8 1/8"	15 7/8"	3/4"	3 7/16"	6 1/2"	218	240	50 1/2" X 20 1/2" X 40 2/10"
38HDR048	1,2	X 0 X	43 3/16"	44 9/16"	17 1/16"	18 7/16"	30 1/2"	19 5/8"	35 3/16"	40 1/16"	14 1/2"	8 1/2"	18 7/8"	7/8"	3 7/16"	6 1/2"	284	309	50 1/2" X 20 1/2" X 46 2/10"
38HDR060	1,2	X 0 X	43 3/16"	44 9/16"	17 1/16"	18 7/16"	30 1/2"	19 5/8"	35 3/16"	40 1/16"	14 1/2"	8 1/2"	18 7/8"	7/8"	3 7/16"	6 1/2"	294	319	50 1/2" X 20 1/2" X 46 2/10"

X = YES  
O = NO

- REQUIRED CLEARANCES: WITH COIL FACING WALL; ALLOW 6" MIN CLEARANCE ON COIL SIDE AND COIL END AND 36" MIN CLEARANCE ON COMPRESSOR END AND FAN SIDE. WITH FAN FACING WALL; ALLOW 8" MIN CLEARANCE ON FAN SIDE AND COIL END AND 36" MIN CLEARANCE ON COMPRESSOR END AND COIL SIDE. WITH MULTI UNIT APPLICATION; ARRANGE UNITS SO DISCHARGE OF ONE DOES NOT ENTER INLET OF ANOTHER.
- MINIMUM OUTDOOR OPERATING AMBIENT IN COOLING MODE IS 35°F, MAX. 125°F.
- SERIES DESIGNATION IS THE 13TH POSITION OF THE UNIT MODEL NUMBER.
- CENTER OF GRAVITY
- ALL DIMENSIONS ARE IN "INCHES" UNLESS NOTED.

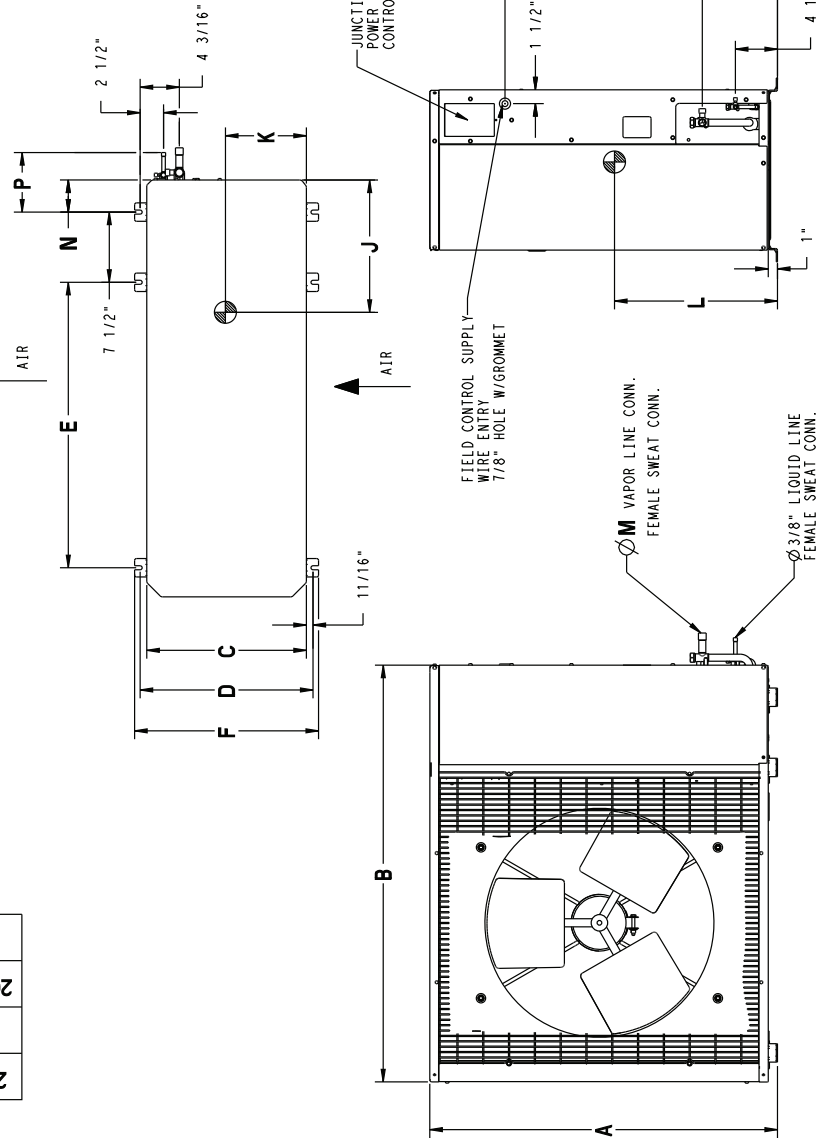

UNIT SIZE	MINIMUM MOUNTING PAD DIMENSIONS
18,24	23" X 42"
30,36,48,60	24" X 50"




# DIMENSIONS - SI

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	A	B	C	D	E	F	G	H	J	K	L	M	N	P	OPERATING WEIGHT(KG)	SHIPPING WEIGHT(KG)	SHIPPING DIMENSIONS (L x W x H)
38HDR018	1	X 0 0	638.2	938.2	369.9	406.4	595.3	436.6	435.0	558.8	330.2	168.3	285.8	15.9	74.6	152.4	70.4	77.7	1090.2 X 457.7 X 714.3
38HDR024	1,2	X 0 0	790.6	938.2	369.9	406.4	595.3	436.6	587.4	711.2	355.6	171.5	295.3	15.9	74.6	152.4	81.8	90.0	1090.2 X 457.7 X 866.7
38HDR030	1	X 0 0	944.6	1131.9	433.4	468.3	774.7	498.5	741.4	865.2	347.7	206.4	403.2	19.0	87.3	165.1	90.9	101.4	1282.7 X 520.7 X 1020.7
38HDR036	1	X 0 X	944.6	1131.9	433.4	468.3	774.7	498.5	741.4	865.2	347.7	206.4	403.2	19.0	87.3	165.1	99.0	109.0	1282.7 X 520.7 X 1020.7
38HDR048	1,2	X 0 X	1097.0	1131.9	433.4	468.3	774.7	498.5	893.8	1017.6	368.3	215.9	479.4	22.2	87.3	165.1	129.0	140.4	1282.7 X 520.7 X 1173.1
38HDR060	1,2	X 0 X	1097.0	1131.9	433.4	468.3	774.7	498.5	893.8	1017.6	368.3	215.9	479.4	22.2	87.3	165.1	133.6	145.0	1282.7 X 520.7 X 1173.1

X = YES  
O = NO

- REQUIRED CLEARANCES: WITH COIL FACING WALL; ALLOW 152.4 MIN CLEARANCE ON COIL SIDE AND COIL END AND 914.4 MIN CLEARANCE ON COMPRESSOR END AND FAN SIDE. WITH FAN FACING WALL; ALLOW 203.2 MIN CLEARANCE ON FAN SIDE AND COIL END AND 914.4 MIN CLEARANCE ON COMPRESSOR END AND COIL SIDE. WITH MULTI UNIT APPLICATION; ARRANGE UNITS SO DISCHARGE OF ONE DOES NOT ENTER INLET OF ANOTHER.
- MINIMUM OUTDOOR OPERATING AMBIENT IN COOLING MODE IS 12.8°C, MAX. 51.7°C.
- SERIES DESIGNATION IS THE 13TH POSITION OF THE UNIT MODEL NUMBER.
- CENTER OF GRAVITY
- ALL DIMENSIONS ARE IN "MM" UNLESS NOTED.

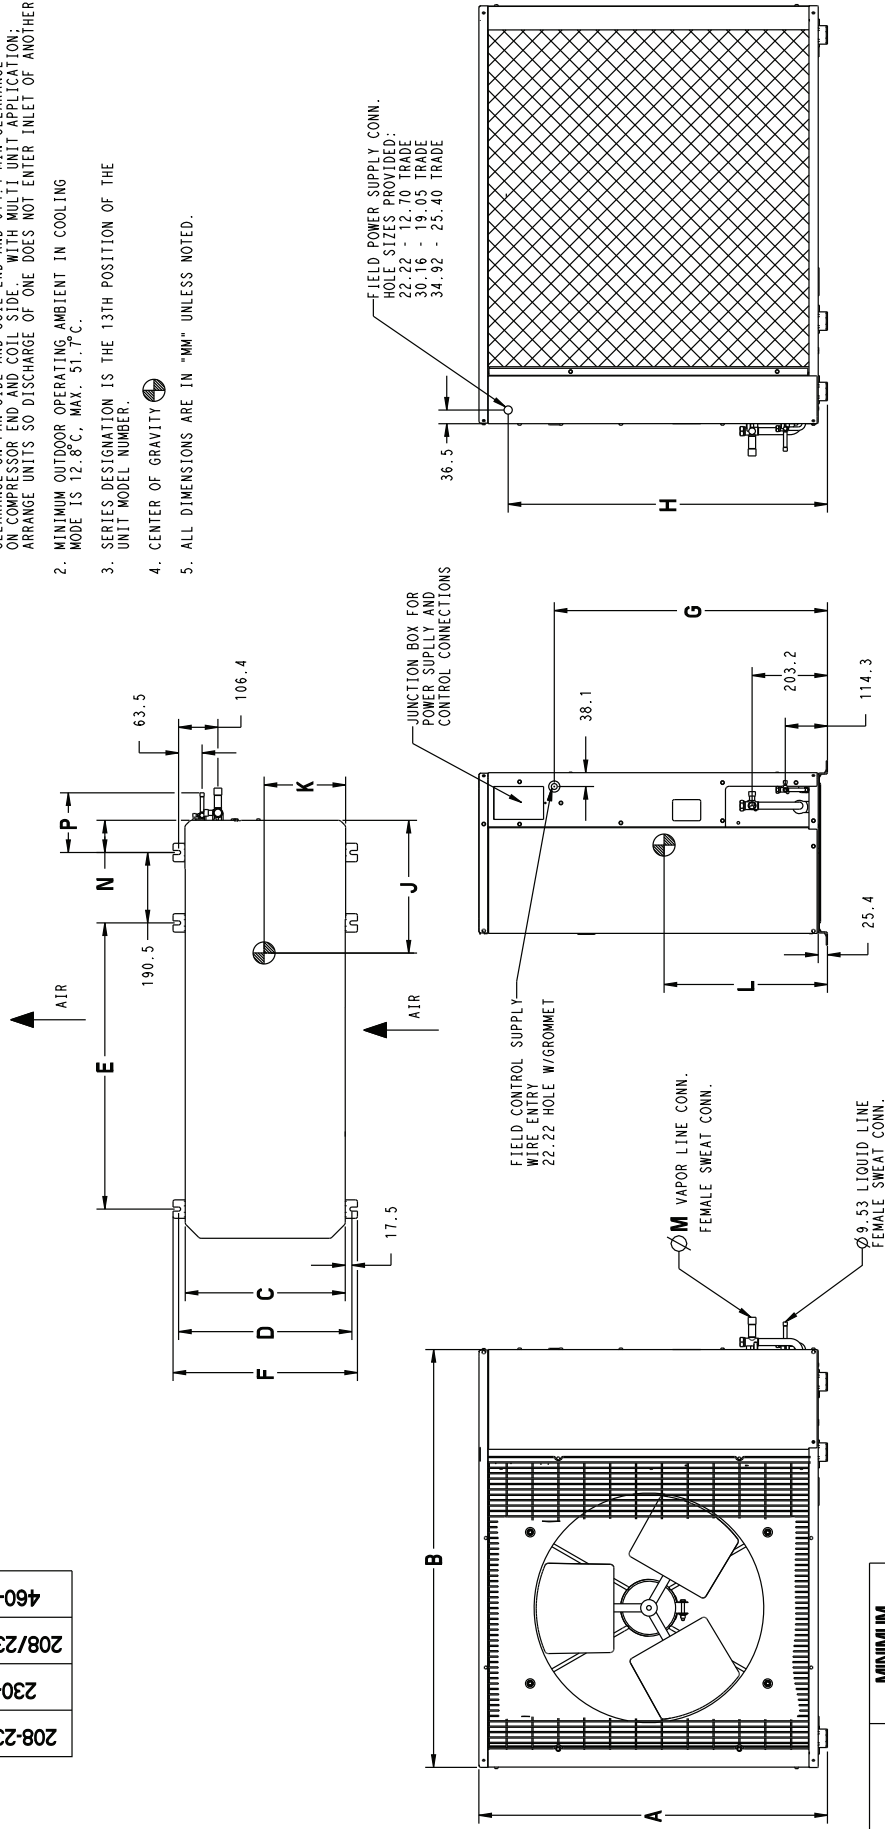

UNIT SIZE	MINIMUM MOUNTING PAD DIMENSIONS
18, 24	584.2 X 1066.8
30, 36, 48, 60	609.6 X 1270.0

**38HDR**

# TESTED AHRI COMBINATION RATINGS\*

NOTE: Ratings contained in this document are subject to change at any time.

For AHRI ratings certificates, please refer to the AHRI directory [www.ahridirectory.org](http://www.ahridirectory.org)

Additional ratings and system combinations can be accessed via the Carrier database at:

[http://cactaxcredits.info/carrier-ratings/ac\\_ratings\\_srch.php](http://cactaxcredits.info/carrier-ratings/ac_ratings_srch.php)

Equipment performance calculator can be accessed at: <http://rpmob.wrightsoft.com/>

Model Number	Indoor Model	Furnace Model	Capacity	EER	SEER
38HDR024-32	CNPV*2414A***+TDR		23,400	11.0	13.0
38HDR030-31	CNPV*3014A***+TDR		28,000	11.0	13.0
38HDR036-31	CNPV*4221A***+TDR		33,400	11.0	13.0
38HDR036-51	CNPV*4221A***+TDR		33,400	11.0	13.0
38HDR036-61	CNPV*4221A***+TDR		33,400	11.0	13.0
38HDR048-32	CNPV*4821A***+TDR		47,000	11.0	13.0
38HDR048-52	CNPV*4821A***+TDR		47,000	11.0	13.0
38HDR048-62	CNPV*4821A***+TDR		47,000	11.0	13.0
38HDR060-32	CNPV*6024A***+TDR		57,000	11.0	13.0
38HDR060-52	CNPV*6024A***+TDR		57,000	11.0	13.0
38HDR060-62	CNPV*6024A***+TDR		57,000	11.0	13.0

\* AHRI = Air Conditioning, Heating & Refrigeration Institute

EER — Energy Efficiency Ratio

SEER — Seasonal Energy Efficiency Ratio

TDR — Time—Delay Relay. In most cases, only 1 method should be used to achieve TDR function. Using more than 1 method in a system may cause degradation in performance. Use either the accessory Time—Delay Relay KAATD0101TDR or a furnace equipped with TDR. Most Carrier furnaces are equipped with TDR.

#### NOTES:

1. Ratings are net values reflecting the effects of circulating fan motor heat. Supplemental electric heat is not included.
2. Tested outdoor/indoor combinations have been tested in accordance with DOE test procedures for central air conditioners. Ratings for other combinations are determined under DOE computer simulation procedures.
3. Determine actual CFM values obtainable for your system by referring to fan performance data in fan coil or furnace coil literature.
4. Do not apply with capillary tube coils as performance and reliability are significantly affected.

# DETAILED COOLING CAPACITIES\*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
CFM	EWB °F (°C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†
		38HDR018 Outdoor Section With CNPV*1814A** Indoor Section																	
525	72 (22.2)	20.28	1.22	9.40	19.31	9.07	1.38	18.30	8.73	1.52	17.26	8.38	1.69	16.14	8.01	1.87	14.90	7.61	2.07
	67 (19.4)	18.53	1.150	11.50	17.65	11.17	1.36	16.72	10.82	1.52	15.76	10.47	1.69	14.72	10.09	1.87	13.59	9.69	2.07
	62 (16.7)	16.93	1.23	13.58	16.13	13.24	1.37	15.29	12.89	1.52	14.43	12.52	1.69	13.57	13.57	1.87	12.71	12.71	2.07
	57 (13.9)	16.35	1.23	16.35	15.72	15.72	1.37	15.05	15.05	1.52	14.34	14.34	1.69	13.57	13.57	1.87	12.71	12.71	2.07
	72 (22.2)	20.65	1.25	9.87	19.63	9.53	1.39	18.59	9.18	1.54	17.50	8.83	1.71	16.34	8.46	1.90	15.05	8.05	2.10
600	67 (19.4)	18.90	1.25	12.25	17.97	11.91	1.39	17.00	11.56	1.55	16.00	11.20	1.72	14.93	10.82	1.90	13.75	10.41	2.10
	62 (16.7)	17.33	1.41	14.61	16.51	14.26	1.39	15.67	15.61	1.55	14.91	14.91	1.72	14.08	14.08	1.90	13.16	13.16	2.10
	57 (13.9)	17.07	1.25	17.07	16.39	16.39	1.39	15.67	15.67	1.55	14.91	14.91	1.72	14.08	14.08	1.90	13.16	13.16	2.10
	72 (22.2)	20.91	1.27	10.30	19.86	9.96	1.41	18.78	9.61	1.57	17.67	9.26	1.74	16.47	8.88	1.93	15.15	8.46	2.13
675	67 (19.4)	19.16	1.27	12.97	18.20	12.62	1.42	17.20	12.27	1.57	16.18	11.90	1.74	15.07	11.52	1.93	13.87	11.09	2.13
	62 (16.7)	17.70	1.28	17.52	16.94	16.94	1.42	16.17	16.17	1.57	15.37	15.37	1.74	14.49	14.49	1.93	13.52	13.52	2.13
	57 (13.9)	17.67	1.28	17.67	16.94	16.94	1.42	16.17	16.17	1.57	15.37	15.37	1.74	14.49	14.49	1.93	13.52	13.52	2.13

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
CFM	EWB °F (°C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†	Capacity MBtu/h	Total System KW**	Sens†
		38HDR024 Outdoor Section With CNPV*2414A** Indoor Section																	
700	72 (22.2)	28.11	1.69	13.59	26.70	13.09	1.89	25.17	12.55	2.10	23.54	11.98	2.33	21.76	11.38	2.58	19.78	10.71	2.84
	67 (19.4)	25.68	1.61	16.61	24.41	16.11	1.87	23.04	15.58	2.09	21.58	15.02	2.32	19.98	14.42	2.57	18.21	13.77	2.83
	62 (16.7)	23.47	1.67	19.61	22.34	19.11	1.86	21.13	18.58	2.08	19.86	18.01	2.31	18.57	18.57	2.55	17.23	17.23	2.82
	57 (13.9)	22.67	1.67	22.67	21.77	21.77	1.86	20.81	20.81	2.07	19.75	19.75	2.31	18.57	18.57	2.55	17.23	17.23	2.82
	72 (22.2)	28.62	1.73	14.25	27.14	13.73	1.93	25.53	13.18	2.14	23.83	12.61	2.37	21.98	11.99	2.62	19.92	11.32	2.88
800	67 (19.4)	26.18	1.72	17.67	24.84	17.16	1.91	23.40	16.61	2.13	21.88	16.05	2.36	20.22	15.43	2.61	18.38	14.76	2.87
	62 (16.7)	24.02	1.71	21.07	22.85	20.54	1.90	21.63	21.51	2.12	20.48	20.48	2.35	19.20	19.20	2.60	17.75	17.75	2.86
	57 (13.9)	23.64	1.71	23.64	22.68	22.68	1.90	21.62	21.62	2.12	20.48	20.48	2.35	19.20	19.20	2.60	17.75	17.75	2.86
	72 (22.2)	28.99	1.77	14.87	27.45	14.34	1.96	25.78	13.78	2.18	24.03	13.20	2.41	22.12	12.57	2.66	20.00	11.89	2.92
900	67 (19.4)	26.54	1.76	18.68	25.15	18.16	1.95	23.66	17.61	2.17	22.09	17.03	2.40	20.36	16.40	2.65	18.50	15.71	2.91
	62 (16.7)	24.51	1.75	22.41	23.41	23.41	1.94	22.28	22.28	2.16	21.06	21.06	2.39	19.70	19.70	2.64	18.15	18.15	2.91
	57 (13.9)	24.45	1.75	24.45	23.41	23.41	1.94	22.28	22.28	2.16	21.06	21.06	2.39	19.70	19.70	2.64	18.15	18.15	2.91

See notes on pg. 13



## DETAILED COOLING CAPACITIES\* (CONT.)

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
CFM	EWB °F (°C)	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**			
		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†	
		<b>38HDR030 Outdoor Section With CNPV*3014A** Indoor Section</b>																	
875	72 (22.2)	33.74	16.03	2.06	32.29	15.52	2.29	30.76	14.99	2.54	29.12	14.43	2.81	27.36	13.84	3.11	25.42	13.19	3.44
	67 (19.4)	30.65	19.58	2.06	29.32	19.06	2.29	27.90	18.51	2.54	26.39	17.94	2.81	24.76	17.34	3.11	22.97	16.69	3.43
	62 (16.7)	28.07	23.01	2.07	26.73	22.59	2.29	25.47	22.03	2.54	24.10	21.45	2.81	22.76	22.72	3.11	21.45	21.45	3.43
	57 (13.9)	27.14	27.14	2.07	26.16	26.16	2.29	25.11	25.11	2.53	24.01	24.01	2.80	22.78	22.78	3.11	21.43	21.43	3.43
	52 (11.1)	26.21	26.21	2.07	25.23	25.23	2.29	24.08	24.08	2.53	23.01	23.01	2.80	21.55	21.55	3.11	20.46	20.46	3.43
1000	72 (22.2)	34.29	16.79	2.11	32.87	16.29	2.34	31.28	15.69	2.58	29.58	15.18	2.86	27.57	14.54	3.17	25.64	13.91	3.49
	67 (19.4)	31.27	20.81	2.11	29.84	20.29	2.34	28.40	19.75	2.58	26.82	19.17	2.86	24.99	18.52	3.16	23.21	17.87	3.49
	62 (16.7)	28.72	24.92	2.11	27.38	24.26	2.34	26.11	26.11	2.58	24.94	24.94	2.85	23.54	23.54	3.16	22.22	22.22	3.48
	57 (13.9)	28.28	28.28	2.11	27.23	27.23	2.34	26.13	26.13	2.58	24.94	24.94	2.85	23.54	23.54	3.16	22.22	22.22	3.48
	52 (11.1)	27.35	27.35	2.11	26.30	26.30	2.34	25.19	25.19	2.58	24.01	24.01	2.85	22.86	22.86	3.16	21.13	21.13	3.48
1125	72 (22.2)	34.76	17.52	2.16	33.30	17.00	2.39	31.65	16.46	2.63	29.90	15.89	2.91	28.03	15.27	3.21	25.95	14.60	3.53
	67 (19.4)	31.86	21.48	2.16	30.25	21.46	2.38	28.76	20.92	2.63	27.14	20.32	2.90	25.39	19.69	3.21	23.44	18.98	3.54
	62 (16.7)	29.27	29.04	2.16	28.12	28.12	2.38	26.98	26.98	2.63	25.71	25.71	2.90	24.35	24.35	3.20	22.84	22.84	3.53
	57 (13.9)	29.23	29.23	2.16	28.13	28.13	2.38	26.99	26.99	2.63	25.71	25.71	2.90	24.23	24.23	3.21	22.85	22.85	3.53
	52 (11.1)	28.30	28.30	2.16	27.29	27.29	2.38	26.06	26.06	2.63	25.71	25.71	2.90	24.23	24.23	3.21	22.85	22.85	3.53
		<b>38HDR036 Outdoor Section With CNPV*4221A** Indoor Section</b>																	
		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
EVAPORATOR AIR		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**			
CFM	EWB °F (°C)	Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†	Total
1050	72 (22.2)	39.85	18.85	2.42	38.03	18.23	2.68	36.08	17.58	2.98	33.99	16.89	3.30	31.72	16.14	3.65	29.20	15.33	4.03
	67 (19.4)	36.33	23.19	2.42	34.67	22.57	2.68	32.91	21.91	2.98	31.02	21.23	3.30	28.99	20.49	3.65	26.73	19.69	4.04
	62 (16.7)	33.23	27.51	2.42	31.75	26.88	2.68	30.20	26.20	2.98	28.80	26.45	3.30	27.06	27.06	3.65	25.34	25.34	4.03
	57 (13.9)	32.46	32.46	2.42	31.26	31.26	2.68	29.98	29.98	2.98	28.59	28.59	3.30	27.06	27.06	3.65	25.34	25.34	4.03
	52 (11.1)	31.53	31.53	2.42	30.33	30.33	2.68	29.05	29.05	2.98	27.66	27.66	3.30	25.34	25.34	3.65	23.44	23.44	4.03
1200	72 (22.2)	40.51	19.77	2.48	38.61	19.14	2.74	36.57	18.47	3.04	34.40	17.77	3.36	32.04	17.01	3.71	29.42	16.18	4.09
	67 (19.4)	36.97	24.67	2.48	35.23	24.04	2.74	33.40	23.38	3.04	31.45	22.68	3.36	29.33	21.93	3.71	27.00	21.10	4.09
	62 (16.7)	34.01	29.52	2.48	32.53	32.23	2.74	31.11	31.11	3.04	29.61	29.61	3.36	27.97	27.97	3.71	26.12	26.12	4.09
	57 (13.9)	33.78	33.78	2.48	32.49	32.49	2.74	31.11	31.11	3.04	29.62	29.62	3.36	27.97	27.97	3.71	26.12	26.12	4.09
	52 (11.1)	32.81	32.81	2.48	31.56	31.56	2.74	30.18	30.18	3.04	28.26	28.26	3.36	26.02	26.02	3.71	24.18	24.18	4.09
1350	72 (22.2)	40.99	20.64	2.54	39.02	19.99	2.80	36.91	19.31	3.09	34.67	18.60	3.42	32.24	17.83	3.77	29.54	16.99	4.15
	67 (19.4)	37.43	26.09	2.54	35.65	25.45	2.80	33.76	24.78	3.10	31.75	24.06	3.42	29.58	23.29	3.77	27.20	22.42	4.15
	62 (16.7)	34.86	34.86	2.54	33.49	33.49	2.80	32.02	32.02	3.10	30.44	30.44	3.42	28.70	28.70	3.77	26.73	26.73	4.15
	57 (13.9)	34.86	34.86	2.54	33.49	33.49	2.80	32.03	32.03	3.10	30.44	30.44	3.42	28.70	28.70	3.77	26.73	26.73	4.15
	52 (11.1)	33.51	33.51	2.54	32.14	32.14	2.80	30.79	30.79	3.10	29.14	29.14	3.42	27.05	27.05	3.77	24.84	24.84	4.15

See notes on pg. 13

# DETAILED COOLING CAPACITIES\* (CONT.)

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																																			
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)																				
		CFM	EWB °F (°C)	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**																			
Total	Sens†			Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†																				
		<b>38HDR048 Outdoor Section With CNPV*4821A** Indoor Section</b>																																			
1460	72 (22.2)	57.22	27.09	3.31	54.16	26.03	3.74	50.83	24.90	4.20	47.23	23.69	4.69	43.24	22.38	5.21	38.87	20.99	5.76																		
	67 (19.4)	52.21	33.21	3.33	49.49	32.17	3.76	46.57	31.08	4.22	43.40	29.91	4.71	39.95	28.66	5.23	36.03	27.26	5.77																		
	62 (16.7)	47.74	39.91	3.35	45.37	38.29	3.78	42.88	37.19	4.23	40.25	39.91	4.72	37.64	37.64	5.23	34.63	34.63	5.78																		
	57 (13.9)	46.44	46.44	3.36	44.53	44.53	3.78	42.48	42.48	4.23	40.21	40.21	4.72	37.65	37.65	5.23	34.63	34.63	5.78																		
	72 (22.2)	58.13	28.26	3.37	54.91	27.17	3.81	51.42	26.01	4.27	47.87	24.78	4.78	43.52	23.45	5.28	39.26	22.10	5.84																		
1650	67 (19.4)	53.07	35.09	3.40	50.21	34.03	3.83	47.16	32.91	4.29	43.87	31.73	4.78	40.28	30.44	5.30	36.23	28.99	5.85																		
	62 (16.7)	48.75	41.89	3.42	46.32	40.79	3.85	43.85	43.85	4.30	41.42	41.42	4.79	38.64	38.64	5.31	35.37	35.37	5.85																		
	57 (13.9)	48.17	48.17	3.43	46.11	46.11	3.85	43.88	43.88	4.30	41.42	41.42	4.79	38.64	38.64	5.31	35.37	35.37	5.85																		
1850	72 (22.2)	58.83	29.41	3.45	55.48	28.31	3.88	51.86	27.12	4.35	47.87	25.87	4.84	43.73	24.52	5.36	39.89	23.26	5.92																		
	67 (19.4)	53.74	36.97	3.48	50.78	35.90	3.91	47.62	34.76	4.37	44.22	33.55	4.86	40.51	32.22	5.38	36.39	30.70	5.93																		
	62 (16.7)	49.74	44.35	3.50	47.48	47.48	3.92	45.09	45.09	4.38	42.44	42.44	4.87	39.46	39.46	5.38	35.96	35.96	5.93																		
57 (13.9)	49.69	49.69	3.50	47.49	47.49	3.92	45.09	45.09	4.38	42.45	42.45	4.87	39.46	39.46	5.38	35.97	35.97	5.93																			
		<b>38HDR060 Outdoor Section With CNPV*6024A** Indoor Section</b>																																			
		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																																			
EVAPORATOR AIR		75 (23.9)						85 (29.4)						95 (35)						105 (40.6)						115 (46.1)						125 (51.7)					
		CFM	EWB °F (°C)	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**	Capacity MBtuht		Total System KW**										
				Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†	Total	Sens†	Total	Sens†				
1750	72 (22.2)	68.88	33.36	4.20	65.13	32.05	4.64	60.97	30.62	5.12	56.47	29.10	5.64	51.66	27.52	6.20	46.31	25.80	6.80																		
	67 (19.4)	63.28	41.18	4.15	59.98	39.91	4.59	56.34	38.52	5.08	52.38	37.05	5.60	48.00	35.44	6.17	43.23	33.69	6.77																		
	62 (16.7)	58.24	48.95	4.11	55.37	47.69	4.55	52.27	46.30	5.04	48.91	46.85	5.57	45.63	45.63	6.15	41.69	41.69	6.76																		
	57 (13.9)	56.77	56.77	4.09	54.45	54.45	4.54	51.86	51.86	5.03	48.95	48.95	5.57	45.63	45.63	6.15	41.69	41.69	6.76																		
	72 (22.2)	69.89	34.93	4.31	65.94	33.59	4.75	61.58	32.12	5.23	56.96	30.59	5.74	52.01	29.02	6.31	47.30	27.45	6.92																		
2000	67 (19.4)	64.28	43.75	4.26	60.81	42.45	4.70	57.00	41.04	5.18	52.88	39.53	5.71	48.32	37.86	6.27	43.82	36.17	6.88																		
	62 (16.7)	59.48	52.47	4.22	56.55	51.08	4.66	53.58	53.58	5.15	50.40	50.40	5.68	46.78	46.78	6.26	42.62	42.62	6.87																		
	57 (13.9)	58.96	58.96	4.21	56.42	56.42	4.66	53.58	53.58	5.15	50.40	50.40	5.68	46.78	46.78	6.26	42.60	42.60	6.87																		
2250	72 (22.2)	70.60	36.41	4.42	66.50	35.04	4.86	61.97	33.55	5.33	57.25	32.02	5.85	52.14	30.44	6.41	48.41	29.01	7.04																		
	67 (19.4)	65.01	46.21	4.37	61.41	44.89	4.81	57.46	43.44	5.29	53.20	41.88	5.81	48.56	40.17	6.37	44.28	38.42	6.99																		
	62 (16.7)	60.67	60.67	4.33	58.00	58.00	4.78	54.94	54.94	5.26	51.52	51.52	5.79	47.63	47.63	6.36	43.18	43.18	6.98																		
57 (13.9)	60.73	60.73	4.33	58.00	58.00	4.78	54.94	54.94	5.26	51.52	51.52	5.79	47.63	47.63	6.36	43.14	43.14	6.98																			

**NOTE:** When the required data fall between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

\* Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per the latest edition of AHRI standard 210/240. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80° F (27° C) entering air at the indoor coil. For sensible capacities at other than 80° F (27° C), deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80° F (27° C), or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80° F (27° C).

When the required data fall between the published data, interpolation may be performed.

\*\* Total system kW is total of indoor and outdoor unit kilowatts.



# CONDENSER ONLY RATINGS\*

SST °F (°C)		CONDENSER ENTERING AIR TEMPERATURES °F (°C)							
		55 (12.8)	65 (18.3)	75 (23.9)	85 (29.4)	95 (35)	105 (40.6)	115 (46.1)	125 (51.7)
<b>38HDR018-31</b>									
30 (-1.6)	TCG	16.20	15.30	14.30	13.40	12.40	11.40	10.30	9.20
	SDT	67.40	77.00	86.50	96.00	105.50	114.90	124.40	133.70
	KW	0.86	0.98	1.11	1.26	1.42	1.59	1.77	1.96
35 (1.7)	TCG	17.90	16.90	15.90	14.80	13.80	12.70	11.60	10.40
	SDT	68.50	78.00	87.50	97.00	106.40	115.80	125.20	134.50
	KW	0.86	0.98	1.11	1.26	1.42	1.59	1.78	1.98
40 (4.4)	TCG	19.70	18.60	17.50	16.40	15.20	14.10	12.90	11.60
	SDT	69.70	79.10	88.60	98.00	107.40	116.80	126.10	135.30
	KW	0.85	0.97	1.11	1.26	1.42	1.60	1.79	1.99
45 (7.2)	TCG	21.60	20.40	19.20	18.00	16.80	15.50	14.20	12.80
	SDT	70.90	80.30	89.70	99.00	108.40	117.70	127.00	136.10
	KW	0.85	0.97	1.11	1.26	1.42	1.60	1.79	2.00
50 (10)	TCG	23.60	22.30	21.10	19.70	18.40	17.00	15.60	14.10
	SDT	72.20	81.50	90.80	100.10	109.40	118.60	127.80	136.90
	KW	0.85	0.97	1.11	1.26	1.42	1.60	1.79	2.00
55 (12.8)	TCG	25.70	24.30	22.90	21.50	20.00	18.60	17.00	15.40
	SDT	73.50	82.70	92.00	101.20	110.40	119.60	128.70	137.70
	KW	0.85	0.97	1.10	1.25	1.42	1.60	1.79	2.00
<b>38HDR024-32</b>									
30 (-1.6)	TCG	22.10	20.90	19.60	18.30	16.90	15.50	14.00	12.40
	SDT	69.00	78.50	88.00	97.40	106.80	116.10	125.30	134.50
	KW	1.08	1.24	1.41	1.60	1.80	2.02	2.25	2.48
35 (1.7)	TCG	24.30	23.00	21.70	20.30	18.80	17.20	15.60	13.80
	SDT	70.30	79.80	89.20	98.60	107.90	117.10	126.30	135.40
	KW	1.09	1.24	1.42	1.61	1.82	2.04	2.28	2.52
40 (4.4)	TCG	26.80	25.30	23.90	22.30	20.70	19.00	17.20	15.30
	SDT	71.70	81.10	90.50	99.80	109.10	118.20	127.30	136.30
	KW	1.10	1.26	1.43	1.62	1.83	2.06	2.30	2.55
45 (7.2)	TCG	29.40	27.80	26.20	24.50	22.70	20.90	18.90	16.70
	SDT	73.20	82.60	91.90	101.10	110.20	119.30	128.30	137.10
	KW	1.11	1.27	1.44	1.64	1.85	2.08	2.32	2.57
50 (10)	TCG	32.10	30.40	28.60	26.80	24.80	22.70	20.50	18.10
	SDT	74.80	84.10	93.30	102.40	111.50	120.40	129.20	137.90
	KW	1.12	1.28	1.46	1.65	1.86	2.09	2.33	2.59
55 (12.8)	TCG	35.00	33.10	31.20	29.10	26.90	24.60	22.20	19.50
	SDT	76.40	85.60	94.70	103.80	112.70	121.50	130.20	138.60
	KW	1.13	1.29	1.47	1.66	1.88	2.10	2.35	2.60
<b>38HDR030-31</b>									
30 (-1.6)	TCG	26.20	24.70	23.20	21.70	20.10	18.40	16.80	15.30
	SDT	72.00	82.30	92.90	103.80	115.00	126.90	139.00	148.90
	KW	1.30	1.48	1.69	1.92	2.19	2.50	2.84	3.12
35 (1.7)	TCG	28.80	27.30	25.70	24.10	22.40	20.60	18.90	17.40
	SDT	73.10	83.50	94.00	104.80	116.10	127.70	139.50	149.30
	KW	1.30	1.49	1.69	1.93	2.21	2.52	2.86	3.15
40 (4.4)	TCG	31.70	30.10	28.40	26.60	24.80	23.00	21.20	19.60
	SDT	74.30	84.70	95.20	105.90	117.10	128.60	140.00	149.70
	KW	1.31	1.49	1.70	1.94	2.22	2.53	2.87	3.18
45 (7.2)	TCG	34.80	33.10	31.20	29.40	27.40	25.50	23.60	21.90
	SDT	75.60	85.90	96.40	107.10	118.10	129.40	140.60	150.10
	KW	1.31	1.50	1.71	1.95	2.22	2.54	2.88	3.19
50 (10)	TCG	38.20	36.20	34.30	32.30	30.30	28.20	26.20	24.40
	SDT	76.90	87.20	97.60	108.20	119.20	130.30	141.10	150.50
	KW	1.32	1.50	1.71	1.95	2.23	2.55	2.89	3.20
55 (12.8)	TCG	41.70	39.70	37.60	35.50	33.30	31.10	29.00	27.10
	SDT	78.30	88.50	98.90	109.40	120.20	131.20	141.80	150.90
	KW	1.32	1.51	1.72	1.96	2.24	2.55	2.89	3.20
<b>38HDR036-31</b>									
30 (-1.6)	TCG	30.10	28.50	26.80	25.10	23.30	21.50	19.60	17.60
	SDT	70.90	80.80	90.90	101.00	111.20	121.60	132.30	143.30
	KW	1.50	1.71	1.94	2.20	2.50	2.83	3.19	3.58
35 (1.7)	TCG	33.20	31.50	29.70	27.80	25.90	24.00	21.90	19.90
	SDT	72.00	82.00	92.00	102.10	112.30	122.80	133.30	143.80
	KW	1.50	1.71	1.95	2.21	2.52	2.85	3.21	3.60
40 (4.4)	TCG	36.50	34.60	32.70	30.70	28.70	26.60	24.40	22.30
	SDT	73.30	83.20	93.20	103.20	113.40	123.60	134.10	144.50
	KW	1.51	1.72	1.95	2.22	2.52	2.85	3.23	3.63
45 (7.2)	TCG	40.10	38.10	36.00	33.80	31.70	29.40	27.10	24.80
	SDT	74.60	84.40	94.40	104.50	113.80	124.50	135.20	145.30
	KW	1.51	1.72	1.96	2.23	2.51	2.86	3.26	3.65
50 (10)	TCG	43.90	41.70	39.50	37.10	34.90	32.40	30.00	27.60
	SDT	75.90	85.80	95.70	105.90	115.50	125.90	136.20	146.00
	KW	1.52	1.73	1.97	2.24	2.54	2.89	3.27	3.66
55 (12.8)	TCG	48.00	45.70	43.30	40.70	38.30	35.70	33.10	30.50
	SDT	77.40	87.10	97.00	107.10	116.70	126.80	137.00	146.70
	KW	1.53	1.74	1.98	2.25	2.55	2.89	3.28	3.66

See notes on page 15

# CONDENSER ONLY RATINGS\* CONTINUED

SST °F (°C)		CONDENSER ENTERING AIR TEMPERATURES °F (°C)							
		55 (12.8)	65 (18.3)	75 (23.9)	85 (29.4)	95 (35)	105 (40.6)	115 (46.1)	125 (51.7)
<b>38HDR048-32</b>									
30 (-1.6)	TCG	48.40	45.50	42.50	39.50	36.20	32.90	30.60	28.10
	SDT	67.90	77.30	86.70	96.00	105.40	114.70	124.30	133.80
	KW	2.05	2.39	2.75	3.15	3.56	4.01	4.49	5.00
35 (1.7)	TCG	53.40	50.20	46.90	43.40	39.60	35.70	34.00	25.50
	SDT	69.10	78.40	87.80	97.00	106.20	115.40	125.10	133.00
	KW	2.02	2.37	2.74	3.14	3.56	4.01	4.51	4.99
40 (4.4)	TCG	58.70	55.10	51.40	47.50	43.10	38.30	33.00	27.10
	SDT	70.40	79.60	88.90	98.00	107.10	116.10	124.80	133.40
	KW	1.99	2.35	2.72	3.13	3.55	4.01	4.49	4.99
45 (7.2)	TCG	64.30	60.30	56.20	51.60	46.90	41.20	35.20	28.90
	SDT	71.80	80.90	90.00	99.10	108.10	116.80	125.40	133.80
	KW	1.96	2.32	2.70	3.11	3.54	4.00	4.48	4.99
50 (10)	TCG	70.30	65.80	61.10	55.80	50.40	44.20	37.30	34.60
	SDT	73.30	82.30	91.20	100.10	108.90	117.50	125.90	135.30
	KW	1.92	2.29	2.68	3.09	3.52	3.98	4.46	5.01
55 (12.8)	TCG	76.50	71.40	66.00	60.30	54.00	47.00	50.70	41.10
	SDT	74.80	83.60	92.50	101.20	109.80	118.20	129.40	137.00
	KW	1.88	2.25	2.64	3.06	3.49	3.95	4.57	5.05
<b>38HDR060-32</b>									
30 (-1.6)	TCG	59.30	55.30	50.90	46.20	40.40	37.90	33.80	30.30
	SDT	70.10	79.30	88.40	97.40	106.20	115.80	124.90	134.20
	KW	2.59	2.93	3.31	3.73	4.19	4.72	5.31	5.90
35 (1.7)	TCG	64.70	60.20	55.50	50.00	43.30	42.40	31.50	33.10
	SDT	71.40	80.50	89.50	98.40	106.90	116.90	124.20	134.90
	KW	2.62	2.97	3.34	3.76	4.21	4.76	5.25	5.93
40 (4.4)	TCG	69.90	65.30	60.10	53.80	55.90	47.40	31.70	35.60
	SDT	72.70	81.70	90.60	99.30	110.10	118.10	124.20	135.50
	KW	2.66	3.00	3.38	3.78	4.34	4.81	5.24	5.96
45 (7.2)	TCG	76.00	70.80	64.80	57.40	56.00	54.60	48.50	47.70
	SDT	74.10	83.00	91.80	100.20	110.00	119.90	128.60	138.80
	KW	2.71	3.04	3.40	3.80	4.32	4.89	5.43	6.08
50 (10)	TCG	82.20	76.70	69.30	70.90	61.80	58.60	30.50	52.10
	SDT	75.60	84.40	92.80	103.40	111.40	120.90	123.80	139.80
	KW	2.75	3.09	3.42	3.99	4.38	4.93	5.16	6.13
55 (12.8)	TCG	95.20	87.70	88.40	74.60	75.40	53.90	46.10	60.30
	SDT	78.80	87.10	97.50	104.30	114.70	119.50	127.70	141.70
	KW	2.85	3.13	3.74	3.95	4.56	4.78	5.33	6.25

\* AHRI listing applies only to systems shown in Combination Ratings table.

**KW** – Outdoor Unit Kilowatts Only.

**SDT** – Saturated Temperature Leaving Compressor (°F)

**SST** – Saturated Temperature Entering Compressor (°F/°C)

**TCG** – Gross Cooling Capacity (1000 Btuh)

**38HDR**

# GUIDE SPECIFICATIONS

## GENERAL

### System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air horizontally as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

### Quality Assurance

- Unit will be rated in accordance with the latest edition of AHRI Standard 210.
- Unit will be certified for capacity and efficiency, and listed in the latest AHRI directory.
- Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have c-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils will be leak tested and pressure tested
- Unit constructed in ISO9001 approved facility.

### Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

### Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

## PRODUCTS

### Equipment

- Factory assembled, single piece, air-cooled air conditioner unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A), and special features required prior to field start-up.

### Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

### Fans

- Condenser fan will be direct-drive propeller type, discharging air horizontally.

## AIR-COOLED, SPLIT-SYSTEM AIR CONDITIONER

38HDR

1-1/2 TO 5 NOMINAL TONS

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings. Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with coated steel wire safety guards.

### Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.

### Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

### Refrigeration Components

- Refrigeration circuit components will include liquid-line front-seating shutoff valve with sweat connections, vapor-line front-seating shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, and compressor oil.
- Unit will be equipped with high-pressure switch, low pressure switch and filter drier for Puron refrigerant.

### Operating Characteristics

- The capacity of the unit will meet or exceed \_\_\_\_\_ Btuh at a suction temperature of \_\_\_\_\_ °F/°C. The power consumption at full load will not exceed \_\_\_\_\_ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of \_\_\_\_\_ Btuh or greater at conditions of \_\_\_\_\_ CFM entering air temperature at the evaporator at \_\_\_\_\_ °F/°C wet bulb and \_\_\_\_\_ °F/°C dry bulb, and air entering the unit at \_\_\_\_\_ °F/°C.
- The system will have a SEER of \_\_\_\_\_ Btuh/watt or greater at DOE conditions.

### Electrical Requirements

- Nominal unit electrical characteristics will be \_\_\_\_\_ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of \_\_\_\_\_ v to \_\_\_\_\_ v.
- Nominal unit electrical characteristics will be \_\_\_\_\_ v, three phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of \_\_\_\_\_ v to \_\_\_\_\_ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.

### Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.



## SYSTEM DESIGN SUMMARY

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. Minimum outdoor operating air temperature without low-ambient operation accessory is 55°F (12.8°C).
3. Maximum outdoor operating air temperature is 125°F (51.7°C).
4. For reliable operation, unit should be level in all horizontal planes.
5. For interconnecting refrigerant tube lengths greater than 80 ft (23.4 m) and/or 35 ft (10.7 m) vertical differential, consult Residential Piping and Longline Guideline and Service Manual available from equipment distributor.
6. If any refrigerant tubing is buried, provide a 6 in. (152.4 mm) vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. (914.4 mm) may be buried without further consideration. Do not bury refrigerant lines longer than 36 in. (914.4 mm).
7. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
8. Do not apply capillary tube indoor coils to these units.
9. Factory-supplied filter drier must be installed.

