


Deep Well Pump Control Valve

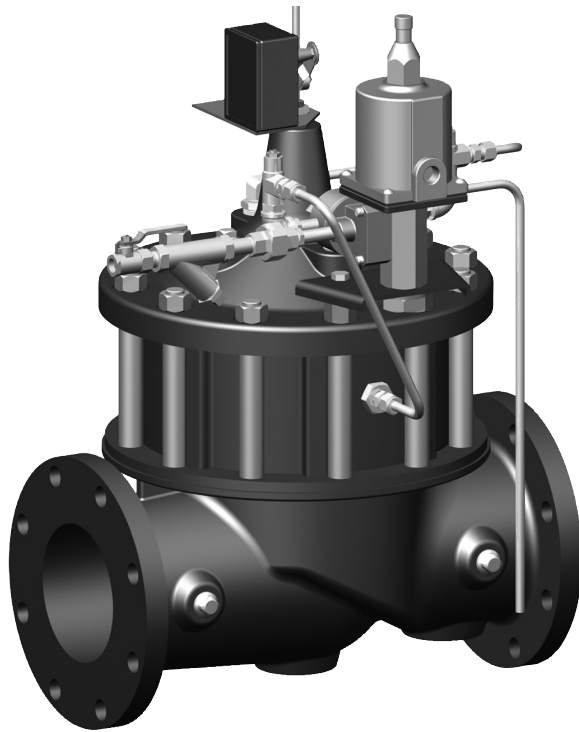

- Prevent Surges in Pipelines
- Simple Hydraulic Operation
- Adjustable Opening and Closing Speeds
- Solenoid Control Can Be Operated Manually
- Proven Reliable Design


The Cla-Val Model 61-02/661-02 Deep Well Pump Control Valve is designed to protect pipelines from surges caused by the starting and stopping of deep well pumps. This is a hydraulically operated diaphragm valve which is controlled by a solenoid pilot valve. Separate adjustable flow control valves in the pilot system regulate the opening and closing rates. A limit switch on the valve stem serves as an electrical interlock between the valve and the pump motor.

The operation of the valve is completely automatic and controlled by the solenoid valve. With the pump off, the valve is wide open. When the pump is started, the solenoid is energized and the valve begins to close slowly, discharging air and the initial rush of sand and water from the pump column to atmosphere. As the valve closes the pump output is gradually diverted into the main line, preventing the development of a starting surge.

When it is time to shut-off the pump, the solenoid is de-energized. The pump continues to run while the pump control valve opens slowly, diverting pump output to atmosphere. As pump pressure gradually decreases, the main line check valve closes slowly, preventing shock or slam during the pump stopping cycle. When the pump control valve is wide open, the limit switch assembly releases the pump starter and the pump stops.

Schematic Diagram


Item	Description
1	Powerrol (Main Valve)
2	CSM11-A2-2 Solenoid Control
3	CV Flow Control
4	X105LOW Switch Assembly
5	CK (Isolation Valve)
6	X43 "Y" Strainer
7	Union

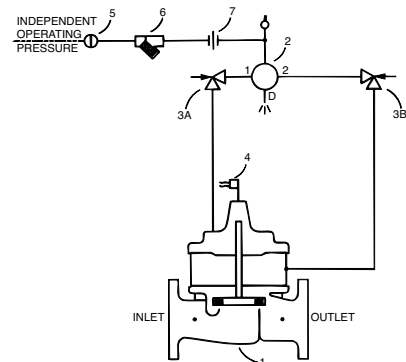

Note: For main valve option descriptions, refer to 100-02 (61-02) or 100-21 (661-02) Technical Data Sheets.

Typical Installation


Install Model 61-02/661-02 valve as shown. Use a minimum of 1/2" tubing to connect operating pressure connection of the valve to the system side of check valve. Flexible conduit should be used for electrical connections to the solenoid control and the limit switch assembly. A Model 52-02/652-03 Surge Anticipator is recommended for power failure and surge protection.

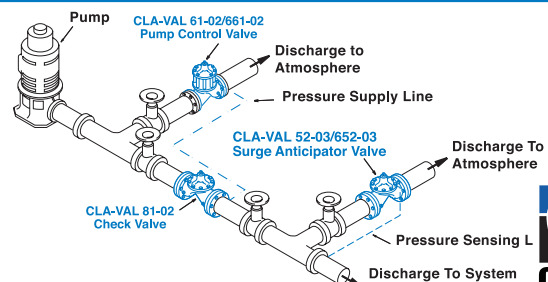

Sequence Of Operation


Pump Off...

With pump off, static line pressure holds the main line check valve “B” closed. Line pressure is transmitted through solenoid control “C” and speed control “D” to the lower chamber of valve “A”. Upper chamber of pump control valve “A” is vented to atmosphere so valve “A” is held wide open.

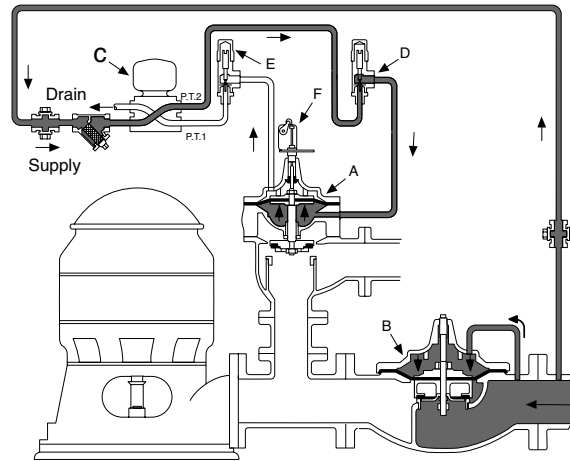

Starting Cycle...

Starting switch closes, pump starts, solenoid “C” energizes and shifts, allowing line pressure to flow into upper chamber of valve “A” through solenoid control “C” and opening speed control “E”. Closing speed of valve “A” is controlled by speed control “D” which limits the rate fluid is relieved from under the diaphragm. As valve “A” closes, pumping pressure opens main line check valve “B”, gradually permitting full flow.

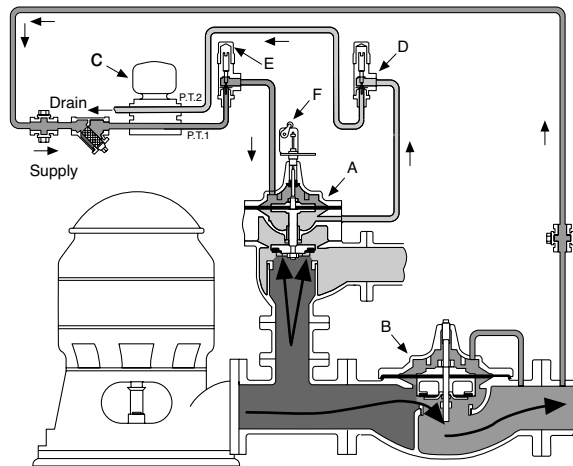


Stopping Cycle...

Starting switch opens, solenoid “C” de-energizes and shifts, as pump continues to run, pump pressure flows into lower chamber of valve “A” through solenoid “C” and opening speed control “D”.



Pressure in upper chamber of valve “A” is relieved to atmosphere through opening speed control “E” and solenoid control “C”.

As valve “A” opens, flow through main line check valve “B” gradually lessens until valve “A” is wide open and the limit switch “F” shuts off the pump.

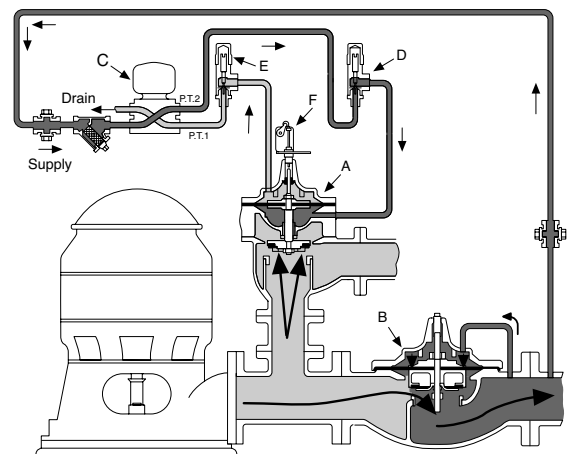


Model 61-02 (Uses Basic Valve Model 100-02)

100-02
(Globe)

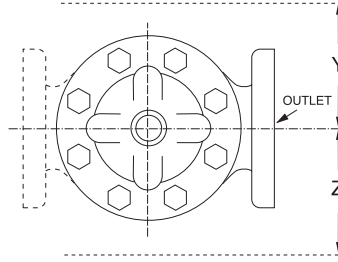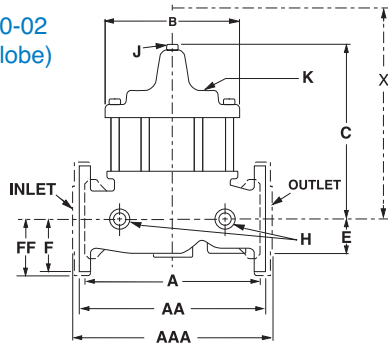

100-02 (Angle)

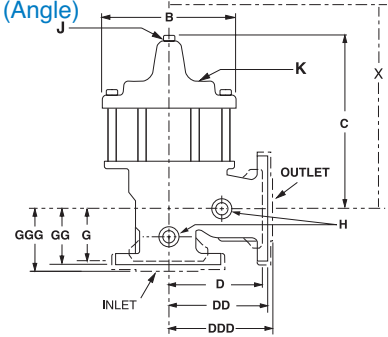


Dimensions (In inches)

Model 61-02 Dimensions (In Inches)

Valve Size (Inches)	2 ½	3	4	6	8	10	12	14	16	24
A Threaded	11.00	12.50	—	—	—	—	—	—	—	—
AA 150 ANSI	11.00	12.00	15.00	20.00	25.38	29.75	34.00	39.00	41.38	61.50
AAA 300 ANSI	11.62	13.25	15.62	21.00	26.38	31.12	35.50	40.50	43.50	63.24
B Dia.	8.00	9.12	11.50	15.75	20.00	23.62	28.00	32.75	35.50	53.16
C Max.	10.31	11.19	14.25	18.44	21.81	23.38	29.31	32.12	35.00	43.93
D Threaded	5.50	6.25	—	—	—	—	—	—	—	—
DD 150 ANSI	5.50	6.00	7.50	10.00	12.69	14.88	17.00	19.50	20.69	—
DDD 300 ANSI	5.81	6.63	7.81	10.50	13.19	15.56	17.75	20.25	21.75	—
E	1.69	2.56	3.19	4.31	5.31	9.25	10.75	12.62	15.50	17.75
F 150 ANSI	3.50	3.75	4.50	5.50	6.75	8.00	9.50	10.50	11.75	19.25
FF 300 ANSI	3.75	4.13	5.00	6.25	7.50	8.75	10.25	11.50	12.75	19.25
G Threaded	4.00	4.50	—	—	—	—	—	—	—	—
GG 150 ANSI	4.00	4.00	5.00	6.00	8.00	8.62	13.75	14.88	15.69	—
GGG 300 ANSI	4.31	4.38	5.31	6.50	8.50	9.31	14.50	15.62	16.50	—
H NPT Body Tapping	½	½	¾	¾	1	1	1	1	1	1
J NPT Cover Center Plug	½	½	¾	¾	1	1	1¼	1½	2	1½
K NPT Cover Tapping	½	½	¾	¾	1	1	1	1	1	1
Valve Stem Internal Thread UNF	10-32	¼-28	¼-28	¾-24	¾-24	¾-24	¾-24	¾-24	½-20	¾-16
Stem Travel	0.7	0.8	1.1	1.7	2.3	2.8	3.4	4.0	4.5	6.75
Approx. Ship Wt. Lbs.	65	95	190	320	650	940	1675	2460	3100	6200
X Pilot System	17.00	18.00	21.00	34.00	37.00	39.00	45.00	48.00	50.00	68.00
Y Pilot System	10.00	11.00	12.00	20.00	42.00	44.00	26.00	29.00	30.00	39.00
Z Pilot System	10.00	11.00	12.00	20.00	42.00	44.00	26.00	29.00	30.00	39.00

Model 61-02 Flow Chart (Based on normal flow through a wide open valve.)

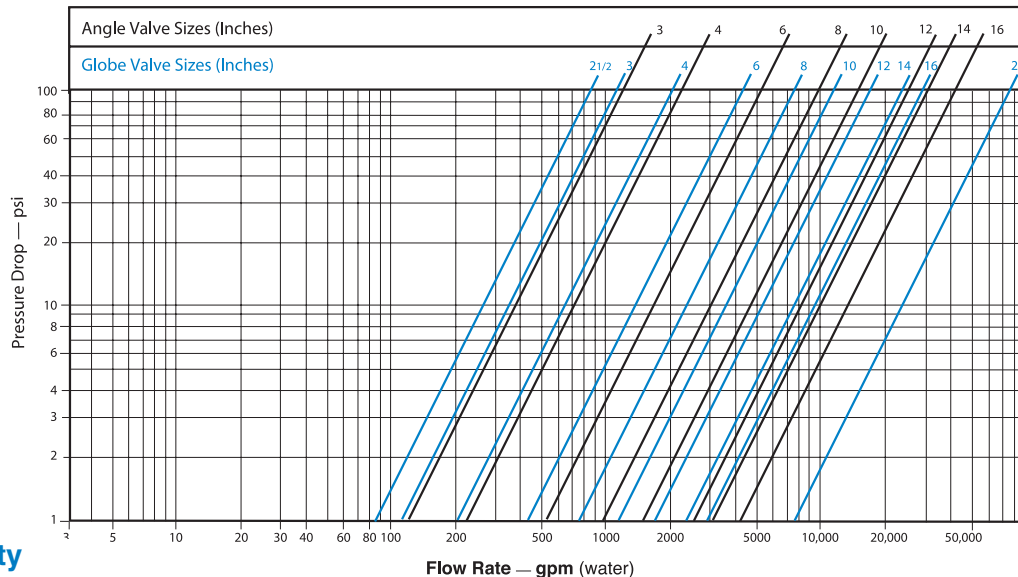

Cover Capacity

Liquid Volume Displaced from Diaphragm Chamber When Valve Opens or Closes										
Sizes (Inches)	2 ½"	3"	4"	6"	8"	10"	12"	14"	16"	24"
Displacement	.043 gal	.080 gal	.169 gal	.531 gal	1.26 gal	2.51 gal	4.00 gal	6.50 gal	9.57 gal	9.57 gal

Selecting The Valve

To be effective, this valve must be sized so it relieves to atmosphere that part of the pump discharge head which is in excess of the normal system static pressure. To do this, the valve is sized to permit the full pump discharge through the valve at a pressure low enough to keep the system check valve from opening. As the pump control valve closes, the pumping pressure exceeds the system pressure and gradually flows into the system.

We recommend selecting a valve size which will have a pressure loss that is at least 10 psi less than the system static pressure. Use the flow rate which is found on the pump's flow vs discharge pressure chart. Select the flow corresponding to the system static pressure, less 10 psi.

Determining Valve Size

1. Determine the system's static pressure (the pressure downstream of the check valve with the pump off); subtract 10 psi, this is the Design Pressure P.
2. From the pump's flow vs. discharge pressure curve, determine the flow (Q) at the Design Pressure P.
3. Using the formula, calculate the Cv.

$$Cv = \frac{Q}{\sqrt{P}}$$

4. Select the valve size from the table which has a Cv that is equal to, or greater than, the calculated Cv in step 3 above.

Example:

1. System Static Pressure with the pump off = 70 psi.
2. Determine the Design Pressure P by subtracting 10 psi (70 psi - 10 psi = 60 psi Design Pressure)
3. From the pump curve we determine that the valve must allow a flow of 800 GPM at 60 psi.
4. Using the Formula:

$$Cv = \frac{Q}{\sqrt{P}} \quad \text{Where: } Q = 800 \text{ GPM} \\ P = 60 \text{ psi (70 psi - 10 psi)}$$

$$\text{Example } Cv = \frac{800}{\sqrt{60}} = 103$$

**Valve Selection Chart
Cv Values**

Valve Size	Globe		Angle	
	61-02	661-02	61-02	661-02
2½	85	—	101	—
3	115	62	139	—
4	200	136	240	135
6	460	229	541	233
8	770	480	990	545
10	1245	930	1575	—
12	1725	1458	2500	—
14	2300	—	3060	—
16	2940	2110	4200	—
20	—	3400	—	—
24	—	3500	—	—

5. From the table above the best valve choices are:

3" 61-02 Globe Pattern
4" 661-02 Globe Pattern
4" 661-02 Angle Pattern

Drain Provisions

Each time the valve opens or closes, water is discharged from the solenoid exhaust port, the amount varying with the valve size. Provisions should be made for the disposal of this water. Exhaust tube must be free of any back pressure. Provide an air gap between the solenoid exhaust tube and drain facility.


Wiring Diagram

Auto-Off-Hand	=	Selector Switch
1CR	=	Relay, DPST Normally Open
2CR	=	Relay, DPST Normally Open
3CR	=	Relay, TPST Normally Open
SW ₁	=	Switch, Remote Start, Automatic
SW ₂	=	Switch, SPDT, Valve Limit Switch Connect to N.C. Terminal
PVS	=	Pilot Valve Solenoid
M	=	Pump Motor Starter

Note:

SW₂ and PVS supplied by Cla-Val Co. PVS is the solenoid control mounted on the valve. SW₂ is included in the X105L switch assembly which is mounted on the pump control valve cover. All other electrical items shall be supplied by customer.



On very deep wells where more than a few seconds are required for the water to reach the surface, or where it is desirable to delay closing the valve, a time delay relay should be installed in the circuit to the solenoid pilot valve.

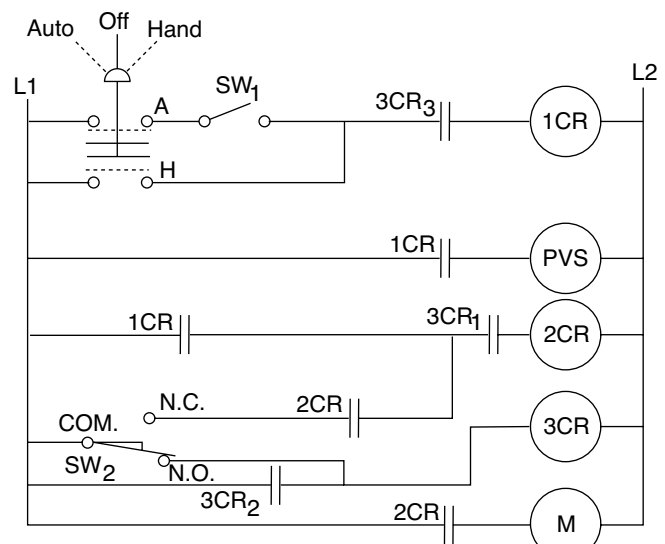


For simplified field wiring see Model PC-1 Pump Control Data Sheet.

Model 661-02 (Uses Basic Valve Model 100-21)

100-21
(Globe)

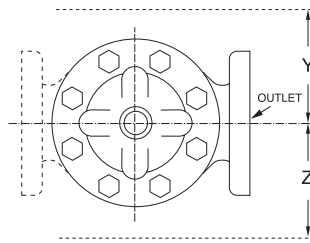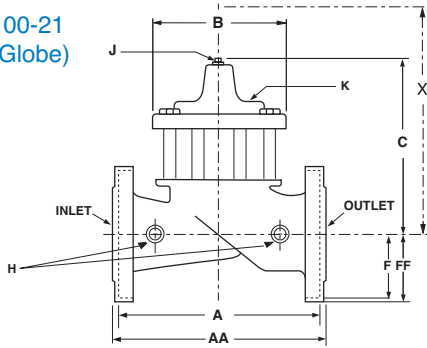

100-21 (Angle)

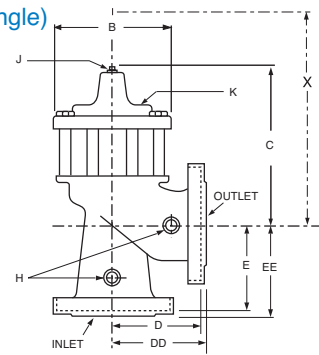


Dimensions (In inches)

Model 661-02 Dimensions (In Inches)

Valve Size (Inches)	3	4	6	8	10	12	14	16	18	20	24	30
A 150 ANSI	10.25	13.88	17.75	21.38	26.00	30.00	34.25	35.00	42.12	48.00	48.00	63.25
AA 300 ANSI	11.00	14.50	18.62	22.38	27.38	31.50	—	36.62	43.62	49.62	49.75	—
B Dia.	6.62	9.12	11.50	15.75	20.00	23.62	28.00	28.00	35.44	35.44	35.44	53.19
C Max.	9.25	11.75	15.25	20.25	23.75	27.25	29.31	34.12	35.00	40.25	40.25	56.50
D 150 ANSI	—	6.94	8.88	10.69	—	—	—	—	—	—	—	—
DD 300 ANSI	—	7.25	9.38	11.19	—	—	—	—	—	—	—	—
E 150 ANSI	—	5.50	6.75	7.25	—	—	—	—	—	—	—	—
EE 300 ANSI	—	5.81	7.25	7.75	—	—	—	—	—	—	—	—
F 150 ANSI	3.75	4.50	5.50	6.75	8.00	9.50	11.00	11.75	15.88	14.56	17.00	19.88
FF 300 ANSI	4.12	5.00	6.25	7.50	8.75	10.25	—	12.75	15.88	16.06	19.00	—
H NPT Body Tapping	3/8	1/2	3/4	3/4	1	1	1	1	1	1	1	1
J NPT Cover Center Plug	1/2	1/2	3/4	3/4	1	1	1 1/4	1 1/4	2	2	2	2
K NPT Cover Tapping	3/8	1/2	3/4	3/4	1	1	1	1	1	1	1	1
Valve Stem Internal Thread UNF	10-32	1/4-28	1/4-28	3/8-24	3/8-24	3/8-24	3/8-24	3/8-24	1/2-20	1/2-20	1/2-20	3/4-16
Stem Travel	0.6	0.8	1.1	1.7	2.3	2.8	3.4	3.4	3.4	4.5	4.5	6.5
Approx. Ship Wt. Lbs.	70	135	230	480	785	1410	2215	2215	2300	3400	3600	7700
X Pilot System	16.00	18.00	31.00	36.00	39.00	43.00	45.00	50.00	50.00	56.00	64.00	81.00
Y Pilot System	10.00	11.00	18.00	20.00	22.00	24.00	26.00	26.00	30.00	30.00	30.00	39.00
Z Pilot System	10.00	11.00	18.00	20.00	22.00	24.00	26.00	26.00	30.00	30.00	30.00	39.00

Model 661-02 Flow Chart (Based on normal flow through a wide open valve.)

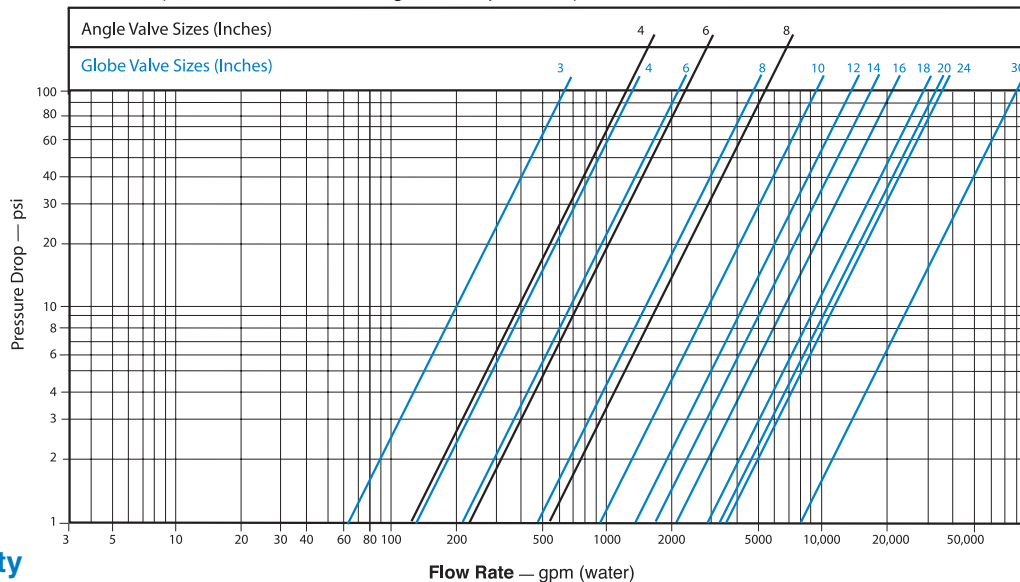

Cover Capacity

Liquid Volume Displaced from Diaphragm Chamber When Valve Opens or Closes										
Sizes (Inches)	3"	4"	6"	8"	10"	12"	16"	20"	24"	30"
Displacement	.032 gal	.080 gal	.169 gal	.531 gal	1.26 gal	2.51 gal	4.00 gal	9.57 gal	9.57 gal	29.00 gal

Valve Selection		These Symbols  and  Indicate Available Sizes												
		Inches	2½	3	4	6	8	10	12	14	16	18	20	24
		mm	65	80	100	150	200	250	300	350	400	450	500	600
		End Detail												
Model 61-02	Basic Valve 100-02	Globe												
		Angle												
	Suggested Flow (gpm)	Max. Continuous	300	460	800	1800	3100	4900	7000	8400	11000			25000
		Max. Intermittent	370	580	990	2250	3900	6150	8720	10540	13700			31300
	Suggested Flow (Liters/Sec)	Max. Continuous	19	29	50	113	195	309	441	529	693			1575
		Max. Intermittent	23	37	62	142	246	387	549	664	863			
Consult Factory for Sizes Not Shown														
Model 661-02	Basic Valve 100-21	Globe												
		Angle												
	Suggested Flow (gpm)	Max. Continuous		260	580	1025	2300	4100	6400	9230	9230	16500	16500	16500
	Suggested Flow (Liters/Sec)	Max. Continuous		16	37	65	145	258	403	581	581	1040	1040	1040

661-02 is the reduced internal port size version of the 61-02.

*Flanged End Detail Only

For 100-02 basic valves, suggested flow calculations were based on flow through Schedule 40 Pipe. Maximum continuous flow is approx. 20 ft/sec (6.1 meters/sec) & maximum intermittent is approx. 25 ft/sec (7.6 meters/sec). For 100-21 basic valves, suggested flow calculations were based on flow through the valve seat. Approx. 26 ft/sec (7.9 meters/sec) is used for maximum continuous flow. Maximum continuous flow through the valve seat for the valve seat for the 30" 100-21 is approx. 20 ft/sec (6.1 meters/sec).

Pressure Ratings (Recommended Maximum Pressure - psi)

Valve Body & Cover		Pressure Class			
		Flanged			Threaded
Grade	Material	ANSI Standards*	150 lb.	300 lb.	End** Details
ASTM A536	Ductile Iron	B16.42	250	400	400
ASTM A216-WCB	Cast Steel	B16.5	285	400	400
ASTM B62	Bronze	B16.24	225	400	400

Note: * ANSI standards are for flange dimensions only.
Flanged valves are available faced but not drilled.
** End Details machined to ANSI B2.1 specifications.

Materials

Component	Standard Material Combinations		
Body & Cover	Ductile Iron	Cast Steel	Bronze
Available Sizes			
61-02	2½" - 24"	2½" - 16"	2½" - 16"
661-02	3" - 30"	3" - 16"	3" - 16"
Disc Retainer & Diaphragm Washer	Cast Iron	Cast Steel	Bronze
Trim: Disc Guide, Seat & Cover Bearing	Bronze is Standard Stainless Steel is optional		
Disc	Buna-N® Rubber		
Diaphragm	Nylon Reinforced Buna-N® Rubber		
Stem, Nut & Spring	Stainless Steel		
For material options not listed, consult factory. Cla-Val manufactures valves in more than 50 different alloys.			

Pilot System Specifications

Temperature Range

Water to 180°F Max

Materials

Standard Pilot System Materials

Pilot Control: Bronze ASTM B62

Trim: Stainless Steel Type 303

Rubber: Buna-N® Synthetic Rubber

Optional Pilot System Materials

Pilot Systems are available with optional

Aluminum, Stainless Steel or Monel

materials at additional cost.

Solenoid Control Specifications

Enclosure General purpose NEMA Type 3;

Aluminum Note: For other enclosures and

NEMA Types, consult factory

Housing Body — Aluminum

Trim — Stainless Steel

Operating Pressure: Maximum pressure 300 psi,

for higher pressure consult factory. AC or DC

Coil Insulation Class A (molded)

AC voltage 15.4 watts

DC voltage 16.8 watts

Power Consumption

Volts (DC)	Amperes		Volts (AC 60 Hz)	Amperes		Coil Resistance (ohms)
	Holding	Pull In		Holding	Inrush	
24	.603	24	24	2.88	25.4	0.5
28	.629	15.6	120	.575	5.1	14.1
32	.500	18.6	208	.330	2.93	40
48	.293	10.8	240	.288	2.54	58
115	.122	4.42	440	.156	1.38	174
125	.119	4.44	480	.143	1.27	233
250	.072	2.45				
			Volts (AC 50 Hz)	Amperes		Coil Resistance (ohms)
				Holding	Inrush	
			110	.48	4.6	15.7
			220	.24	2.3	66
			240	.22	2.1	88

When Ordering, Please Specify

1. Catalog No. 61-02 or No. 661-02
2. Valve Size
3. Pattern - Globe or Angle
4. Pressure Class
5. Threaded or Flanged
6. Trim Material
7. Solenoid Voltage
8. Desired Options
9. When Vertically Installed

Note: For main valve option descriptions, refer to 100-02 (61-02) or 100-21 (661-02) Technical Data Sheets.



CLA-VAL

PO Box 1325 Newport Beach CA 92659-0325
Phone: 949-722-4800 • Fax: 949-548-5441

CLA-VAL CANADA

4687 Christie Drive
Beamsville, Ontario
Canada LOR 1B4
Phone: 905-563-4963
Fax: 905-563-4040

CLA-VAL EUROPE

Chemin des Mesanges 1
CH-1032 Romanel/
Lausanne, Switzerland
Phone: 41-21-643-15-55
Fax: 41-21-643-15-50

©COPYRIGHT CLA-VAL 2007 Printed in USA
Specifications subject to change without notice.

www.cla-val.com

Represented By: