

118-FP

1"-2"

**BRASS GATE, 175 WP, O. S. AND Y.,
SOLID WEDGE DISC, SCREWED BONNET,
GLAND PACKED, SCREWED ENDS
NEW YORK CITY BOARD OF STANDARDS and
APPROVAL**

Approvals: U.L. Listed, F.M.,
N.Y.C. B.S.A. No.1079-81-SA
MEA255-93-E




Fire sprinkler system main gate valve. This valve Features outside stem and yoke to provide positive indication of open or closed position. It is all ASTM B584-C84400 construction with a rugged cast iron handwheel and fast acting stem threading. Milwaukee Valve recommends this valve for 175 psi working pressure in fire protection services, and for 300 WOG and 150 WSP industrial applications.

MATERIALS LIST

ITEM	PART	MATERIAL	SPECIFICATION
1	Stem	Brass	CDA-360
2	Yoke Bushing	Brass	
3	Handwheel	Ductile Iron	
4	Bonnet	Brass	CDA-844
5	Packing Gland	Brass	
6	Packing		
7	Gland Follower Bolt	Stainless Steel	
8	Body	Brass	CDA-844
9	Wedge	Brass	

MATERIALS LIST

	UNTS	1"	1-1/4"	1-1/2"	2"
A	INCHES	2.55	2.81	5.86	3.094
	mm	64.7	71.5	148.8	78.6
B	INCHES	6.55	7.61	7.84	8.88
	mm	166.3	193.3	199.2	225.4
C	INCHES	7.97	9.47	9.75	11.22
	mm	202.4	240.5	247.7	285.0

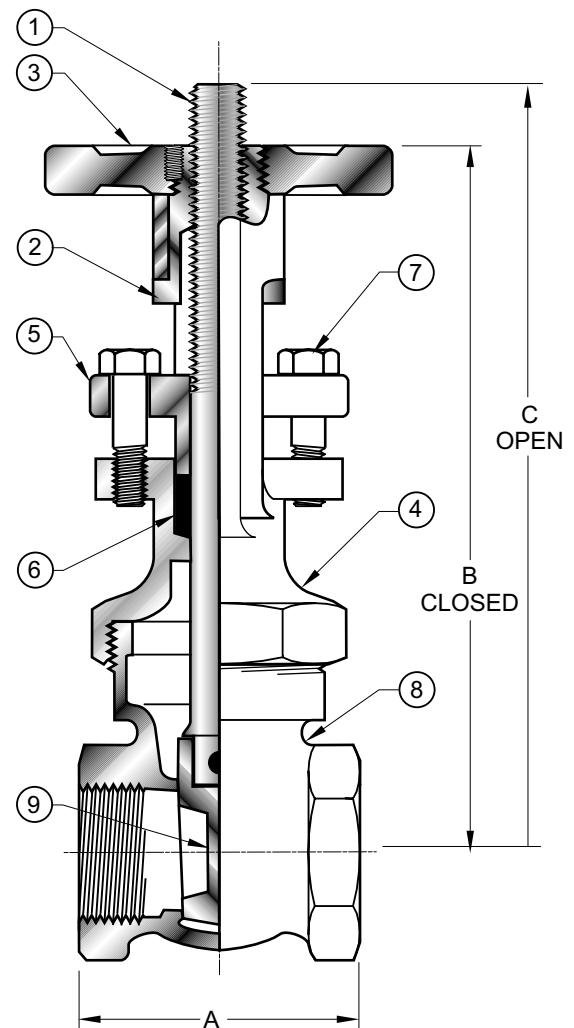

The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the most current information access www.milwaukeevalve.com.

