



## CEILING DAMPER SQUARE AND RECTANGULAR

### Model:

CD-P: No Shroud Required.

### Standard Construction:

**Frame:** Roll formed, 22 ga. galv. steel.

**Blades:** 22 ga. galv. steel with non-asbestos  
UL/ULC classified insulation.

**Fusible Link:** Replaceable 212°F standard.  
Others available.

**Finish:** Mill galvanized.

**Sizes:** Minimum 12"w x 12"h  
(304 mm x 304 mm)  
Maximum 24"w x 24"h  
(609 mm x 609 mm)


**UL/ULC Listing:** 3-4 hours.  
Opening up to  
576 sq. in. (14,630 sq. mm)



LISTED AND LABELLED BY:



DESIGNED AND TESTED IN ACCORDANCE WITH  
UL-555 AND ULC-S112. MEETS ALL NFPA-90A  
REQUIREMENTS FOR FIRE DAMPERS.

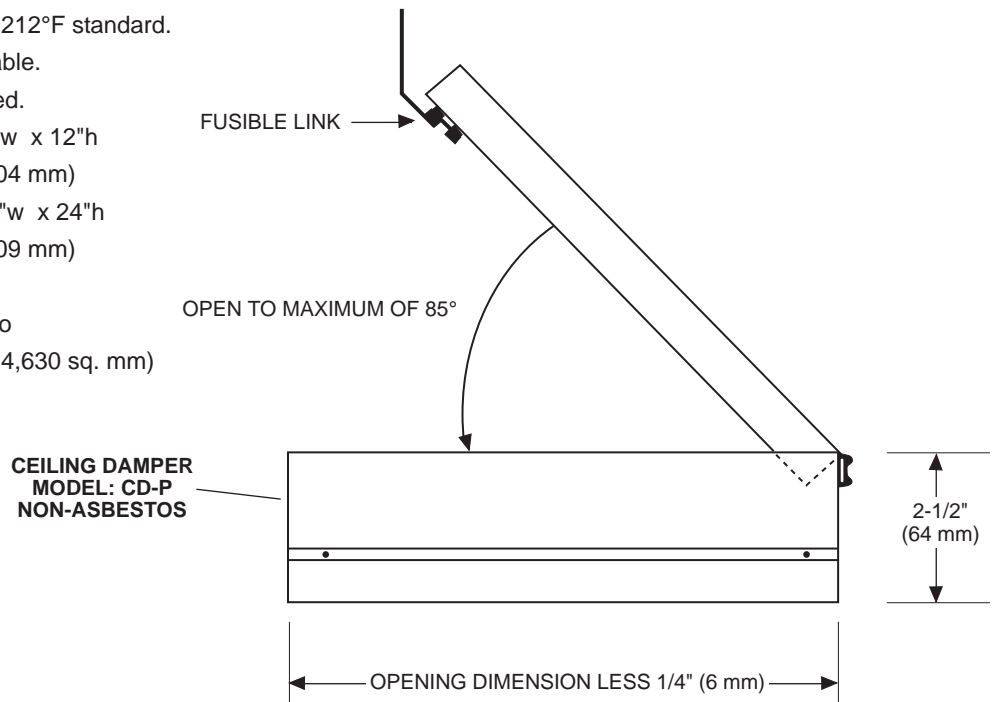

### SUGGESTED SPECIFICATION

Square and rectangular ceiling dampers shall be Model CD-P by NCA Manufacturing. Ceiling dampers shall bear the Underwriters' Laboratories label and be rated for both ducted or non-ducted air systems. Ceiling dampers shall be of the non-asbestos type and shall require no external shroud protection.

#### Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every 2 years in accordance with the latest edition of NFPA 90A, 92A, local and national codes. In addition, the fuse link shall be removed and inspected for corrosion. Dry lubricants are recommended.

Specifications are correct at time of printing. However, as part of our 'continuous improvement program,' we reserve the right to make further improvements without notice.

© 1999 NCA Manufacturing

Project:

Contractor:

Location:

Address:

Architect:

P.O. Number:

Engineer:

Date: