




MODEL FD TYPE C-HP STATIC FIRE DAMPER VERTICAL AND HORIZONTAL WELDED, HIGH PRESSURE (ABOVE 10" STATIC PRESSURE SYSTEMS)

TYPICAL VERTICAL DAMPER

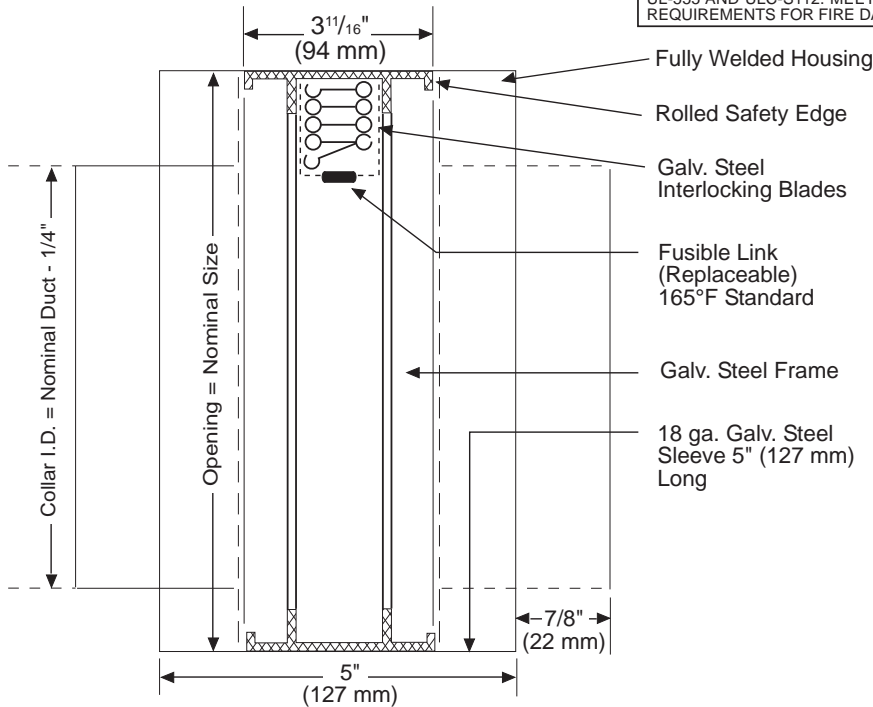

DESIGNED AND TESTED IN ACCORDANCE WITH UL-555 AND ULC-S112. MEETS ALL NFPA-90A REQUIREMENTS FOR FIRE DAMPERS.



LISTED AND LABELLED BY:




OPTIONS:

- Available with round, oval or square/rectangular transitions; with or without collars. Round and oval transitions normally supplied with collars as standard construction. Square/rectangular collars supplied upon request.
- Electro thermal links
- Other fusible links 212°F.
- Adjustable blade stack for combination fire/balancing damper.
- Solenoid release.
- Microswitches for fan shut off and/or status control.
- Stainless steel construction.
- 1-1/2 hr. rating standard, 3 hr. optional.

"These dampers are rated for duct pressure static leakage. Leakage through damper is not rated."

"These Dampers are UL/ULC Approved For Use in Static Systems Where The Fan Shuts Down in the Event of a Fire."

TYPICAL HORIZONTAL DAMPER

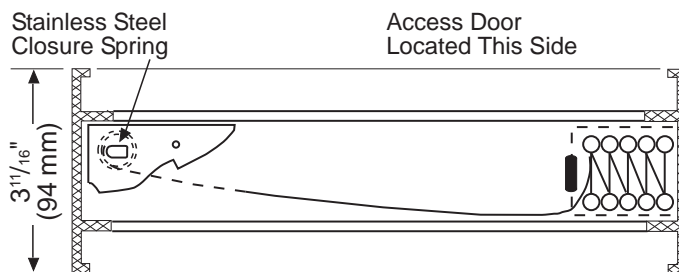


Patent Applied For

Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every six months and in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.

MODELS

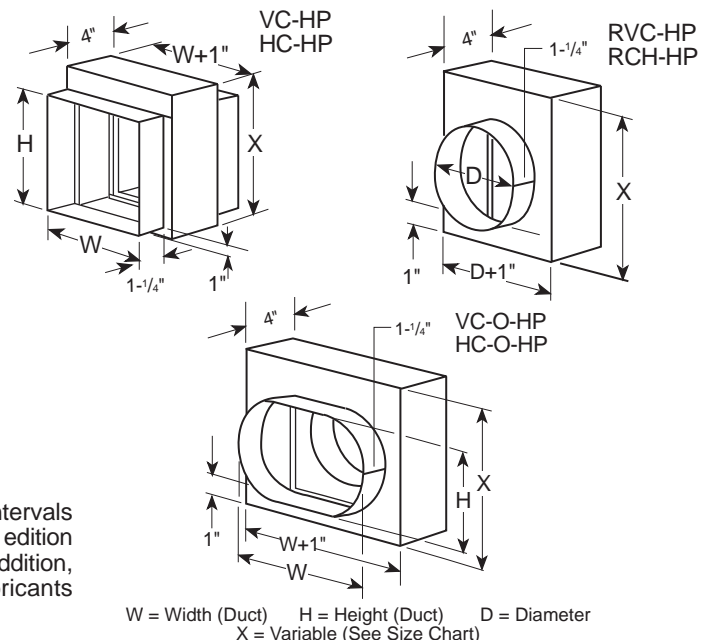

W = Width (Duct) H = Height (Duct) D = Diameter
X = Variable (See Size Chart)

Specifications are correct at time of printing. However, as part of our 'continuous improvement program,' we reserve the right to make further improvements without notice.

© 1999 NCA Manufacturing

Project:

Contractor:

Location:

Address:

Architect:

P.O. Number:

Engineer:

Date: