



MODEL FD-HAG *STATIC CURTAIN TYPE FIRE DAMPERS* *HORIZONTAL MOUNT — 1 1/2 & 3 HOUR*

Standard Construction:

Frame: Roll Formed Galvanized Steel with Safety Edge.

Blades: Roll Formed Galvanized Steel, Curtain-Type

Factory Sleeve: 12" - 20 Ga.

Flange: 3/4"

Springs: Stainless Steel.

Fusible Link: U.L. Listed 165°F.

Max. Size: 36" w X 48" h (914 mm x 1219 mm)

Min. Size: 4" w X 4" h (102 mm x 102 mm)

Mounting: Horizontal


Optional Construction:

- ☐ Factory Supplied Sleeve 18 - 16 - 14 Gauge Sleeve Length (Required)
- ☐ Damper Setback
- ☐ 3 Hour Rating
- ☐ Round Transition (FD-HAGR)
- ☐ Fuse Link 212°F

Notes: Dampers are furnished approximately 1/4" (6.4mm) smaller than given duct dimensions.

"These Dampers are UL/ULC Approved For Use in Static Systems Where The Fan Shuts Down in the Event of a Fire."

FD-HAG
(Shown)

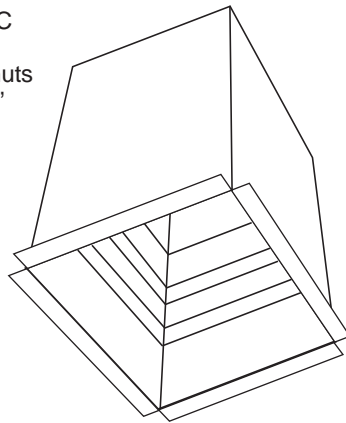


Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every six months and in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.

DESIGNED AND TESTED IN ACCORDANCE WITH UL-555 AND ULC-S112. MEETS ALL NFPA-90A REQUIREMENTS FOR FIRE DAMPERS.


FD-HAG **CEILING/FLOOR GRILLE** **TYPICAL HORIZONTAL DAMPER**

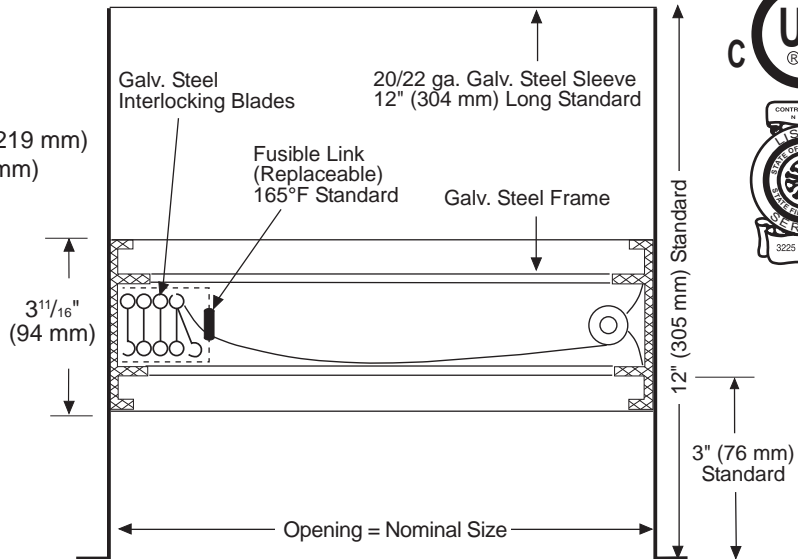

LISTED AND LABELLED BY:



FD-HAGR

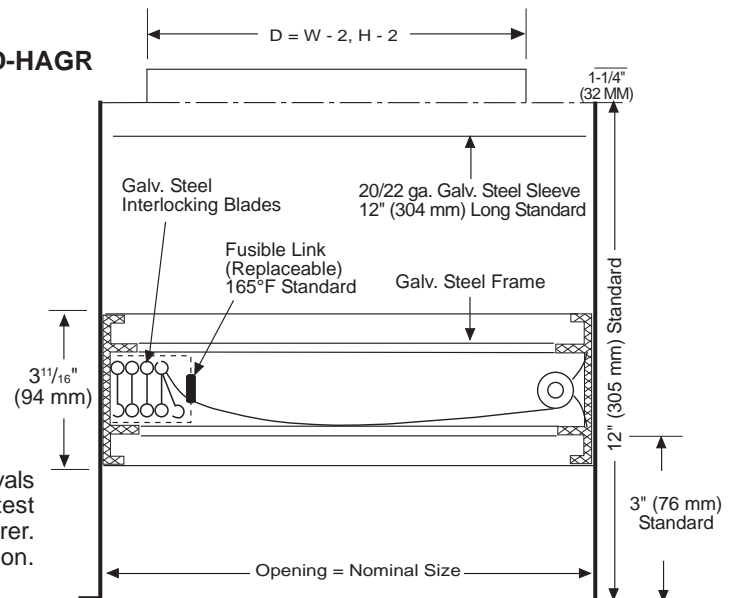

Specifications are correct at time of printing. However, as part of our 'continuous improvement program,' we reserve the right to make further improvements without notice.

© 2003 NCA Manufacturing

FD-HAG - 02-05

Project:

Contractor:

Location:

Address:

Architect:

P.O. Number:

Engineer:

Date: