



MODEL FD-VAG *STATIC CURTAIN TYPE FIRE DAMPERS* *VERTICAL MOUNT — 1¹/₂ & 3 HOUR*

Standard Construction:

Frame: Roll Formed Galvanized Steel with Safety Edge.

Blades: Roll Formed Galvanized Steel, Curtain-Type

Factory Sleeve: 12" - 20 Ga.

Flange: 3/4"

Springs: Stainless Steel.

Fusible Link: U.L. Listed 165°F.

Max. Size: 36" w X 48" h (914 mm x 1219 mm)

Min. Size: 4" w X 4" h (102 mm x 102mm)

Mounting: Vertical

Optional Construction:

- ☐ Factory Supplied Sleeve
18 - 16 - 14 Gauge
Sleeve Length (Required)
- ☐ Damper Setback
- ☐ 3 Hour Rating
- ☐ Round Transition
(FD-VAGR)
- ☐ Fuse Link 212°F



Notes: Dampers are furnished approximately 1/4" (6.4mm) smaller than given duct dimensions.

"These Dampers are UL/ULC Approved For Use in Static Systems Where The Fan Shuts Down in the Event of a Fire."

FD-VAG SIDEWALL GRILLE TYPICAL VERTICAL DAMPER


DESIGNED AND TESTED IN ACCORDANCE WITH UL-555 AND ULC-S112. MEETS ALL NFPA-90A REQUIREMENTS FOR FIRE DAMPERS.

LISTED AND LABELLED BY:

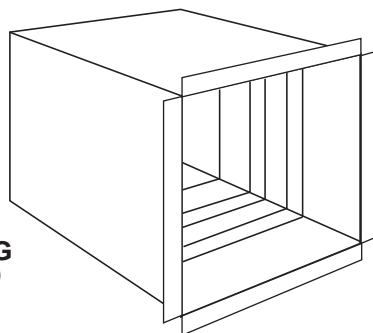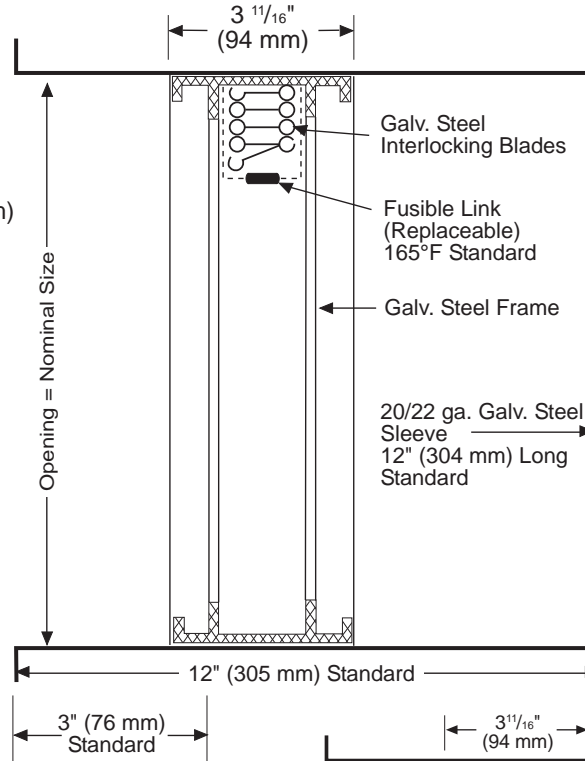

**FD-VAG
 (Shown)**

FD-VAGR

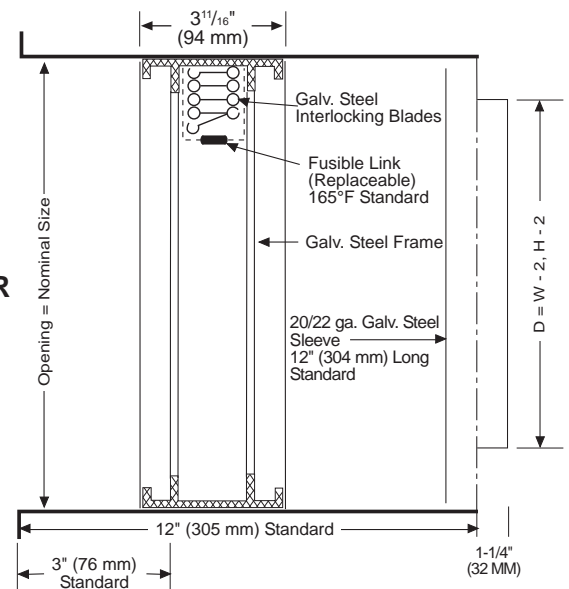

Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every six months and in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.

Specifications are correct at time of printing. However, as part of our 'continuous improvement program,' we reserve the right to make further improvements without notice.

© 2003 NCA Manufacturing

FD-VAG - 02-05

Project:

Contractor:

Location:

Address:

Architect:

P.O. Number:

Engineer:

Date: