

FEATURES

Sizes: ☐ 3/4" ☐ 1" ☐ 1 1/4" ☐ 1 1/2" ☐ 2"

Maximum working water pressure 175 PSI
Maximum working water temperature 180°F
Hydrostatic test pressure 350 PSI
End connections Threaded ANSI B1.20.1

OPTIONS

(Suffixes can be combined)

- ☐ L - less ball valves
- ☐ FT - with "Fast Test" testcocks
- ☐ U - with union ball valves
- ☐ S - with bronze "Y" type strainer

ACCESSORIES

- ☐ Repair kit (rubber only)
- ☐ Thermal expansion tank (Model WXTP)
- ☐ Bronze wye strainer
- ☐ Stainless steel ball valve handles

APPLICATION


Designed for installation on potable water lines to protect against both backsiphonage and backpressure of polluted water into the potable water supply. A tethered test cock cap is provided to protect against fouling caused by insects, dirt and debris. Assembly shall provide protection where a potential non-health hazard exists.

STANDARDS COMPLIANCE

- ☐ ASSE® Listed 1015 (Vertical flow-up: 1 1/2" & 2")
- ☐ IAPMO® Listed
- ☐ AWWA Compliant
- ☐ CSA® Certified
- ☐ Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California

MATERIALS





Main valve body Cast Bronze ASTM B 584
Access covers Cast Bronze ASTM B 584
Fasteners Stainless Steel, 300 Series
Elastomers Silicone (FDA approved)
Buna Nitrile (FDA approved)
Polymers Noryl™, NSF Listed
Springs Stainless steel, 300 series
Test cock cover Plastic

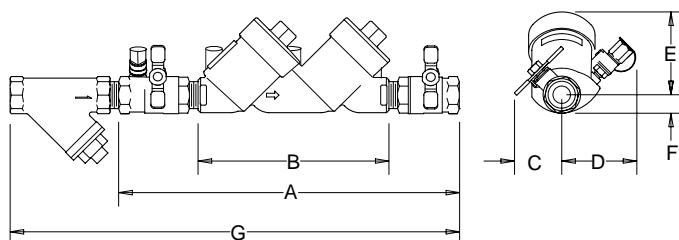

DIMENSIONS & WEIGHTS (do not include pkg.)

| MODEL SIZE | DIMENSIONS (INCHES) | | | | | | | | WEIGHT (LBS) | |
|------------|---------------------|---------------------|--------------------|------|------|------|------|-------|------------------|------------------|
| | A | A UNION BALL VALVES | B LESS BALL VALVES | C | D | E | F | G | LESS BALL VALVES | WITH BALL VALVES |
| 3/4" | 13.00 | 14.30 | 8.75 | 2.40 | 2.30 | 3.30 | 0.75 | 17.60 | 4.0 | 8.0 |
| 1" | 14.75 | 15.50 | 8.75 | 2.50 | 2.30 | 3.30 | 0.75 | 19.75 | 8.0 | 9.0 |
| 1 1/4" | 19.60 | 21.60 | 13.75 | 4.00 | 3.60 | 4.40 | 1.30 | 24.70 | 16.0 | 21.0 |
| 1 1/2" | 20.30 | 22.30 | 13.75 | 5.40 | 3.60 | 4.40 | 1.30 | 25.90 | 16.0 | 24.0 |
| 2" | 21.40 | 23.20 | 13.75 | 5.80 | 3.60 | 4.40 | 1.30 | 28.30 | 17.0 | 28.0 |


FLOW CHARACTERISTICS

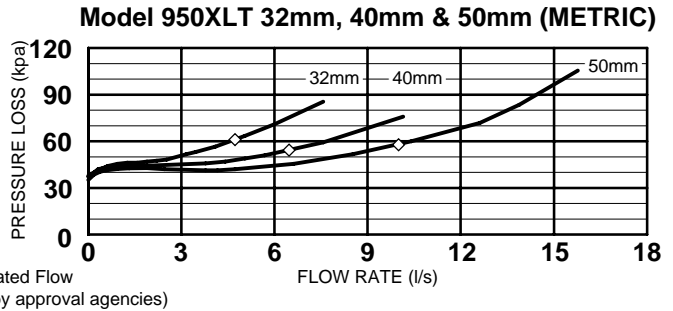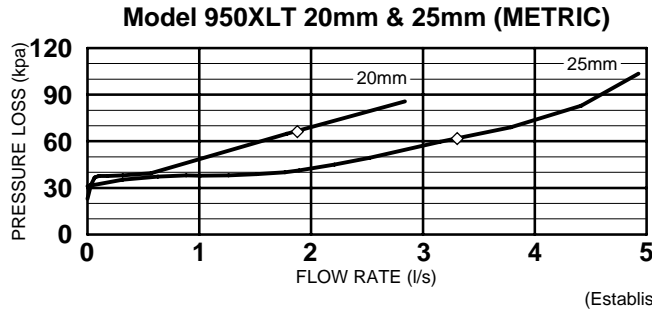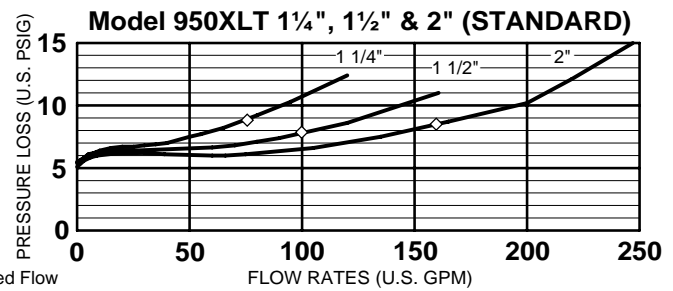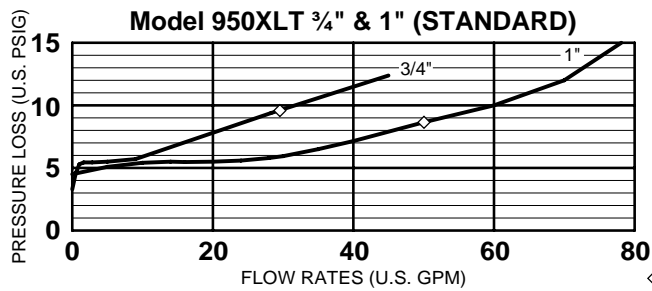


TYPICAL INSTALLATION

Local codes shall govern installation requirements. To be installed in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

| Capacity thru Schedule 40 Pipe | | | | |
|--------------------------------|----------|------------|-----------|-----------|
| Pipe size | 5 ft/sec | 7.5 ft/sec | 10 ft/sec | 15 ft/sec |
| 1/8" | 1 | 1 | 2 | 3 |
| 1/4" | 2 | 2 | 3 | 5 |
| 3/8" | 3 | 4 | 6 | 9 |
| 1/2" | 5 | 7 | 9 | 14 |
| 3/4" | 8 | 12 | 17 | 25 |
| 1" | 13 | 20 | 27 | 40 |
| 1 1/4" | 23 | 35 | 47 | 70 |
| 1 1/2" | 32 | 48 | 63 | 95 |
| 2" | 52 | 78 | 105 | 167 |

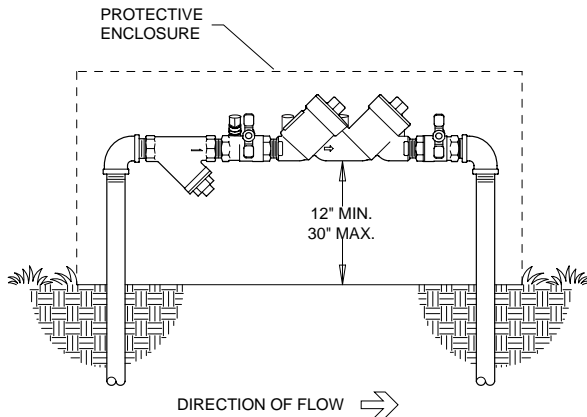

OUTDOOR INSTALLATION

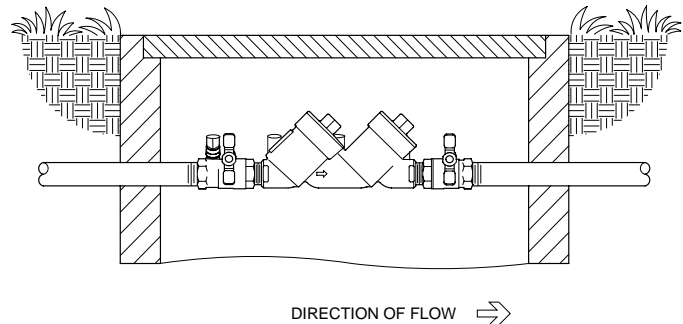

PIT INSTALLATION

SPECIFICATIONS

The double check type backflow preventer shall be ASSE 1015 Listed, rated to 180°F and supplied with full port ball valves. The main body and access covers shall be bronze (ASTM B 584), the seat ring and all internal polymers shall be NSF® Listed Noryl™ and the seat disc elastomers shall be SILICONE. The first and second check shall be located at a 45° angle and accessible for maintenance from the top of the device, without removing the device from the line. Each check shall have separate access covers and testcocks shall be accessible from the top of the device. Testcocks shall be protected from debris by a tethered cap. The double check valve shall be a WILKINS Model 950XLT.